



**TRANE®**

**TRANE**  
TECHNOLOGIES™

REFERENCE DESIGN #502

# HIGH-EFFICIENCY COOLING FOR THE 1 GW AI FACTORY

CenTraVac® Simplex, High Condenser  
Temperature Reference Design

A scalable reference design that cuts energy,  
water use and cost.





# INTRODUCTION

Artificial intelligence is driving massive growth in data center demand — and advanced cooling is critical to keep innovation running. Trane leads the way with proven thermal management solutions for AI factories and data centers of all sizes.

## This reference design provides:

- ✓ A 1 GW cooling blueprint for AI factory applications
- ✓ Integrated air- and liquid-cooling configurations for NVIDIA racks
- ✓ Guidance on CDUs, fan coil walls, chillers, dry coolers, pumps and facility piping
- ✓ A foundation for mechanical design that complements electrical and controls systems



# DESIGN OVERVIEW

## Temperature and Flow Rates

This table summarizes temperature and flow rate requirements for the water-cooled chillers in this reference design. These values represent an AI factory installed in Albuquerque, NM and can be adjusted for specific applications.

**Technical Loop Supply Temperature:** 30°C (86°F)

**Technical Loop Return Temperature:** 40°C (104°F)

**Fan Coil Wall Supply Air Temperature:** 27°C (80.6°F)

	Medium Temperature (Airside)	High Temperature (Liquid Direct to Chip)
<b>Total Block Load</b>	13.74MW (3,906T)	102.4MW (29,120T)
<b>Load Requirement/Chiller</b>	6.87MW (1,953T)	10.24MW (2,912T)
<b>Evaporator Flow Rate/Chiller</b>	9,809 LPM (2592.9 GPM)	13,187 LPM (3,485.1GPM)
<b>Facility Loop Temperature (Return)</b>	32°C (89.6°F)	36°C (96.8°F)
<b>Facility Loop Temperature (Supply)</b>	22°C (71.6°F)	26°C (78.8°F)
<b>Facility Loop Fluid</b>	Water	Water
<b>Condenser Flow Rate/Chiller</b>	11,854 LPM (3130.5 GPM)	15,526 LPM (4,103.3 GPM)
<b>Heat Rejection Loop Temperature (High)</b>	58.9°C (138°F)	58.9°C (138°F)
<b>Heat Rejection Loop Temperature (Low)</b>	48.9°C (120°F)	48.9°C (120°F)
<b>Heat Rejection Loop Fluid</b>	Water	Water
<b>Max Ambient (Albuquerque, NM)</b>	40°C (104°F)	
<b>Elevation (Albuquerque, NM)</b>		1,619m (5,312')


## DESIGN OVERVIEW

### Reference Diagram

✓ 1 GW mechanical cooling blueprint for AI factories

✓ Integrates air- and liquid-cooling systems

✓ Modular structure for scalability and serviceability

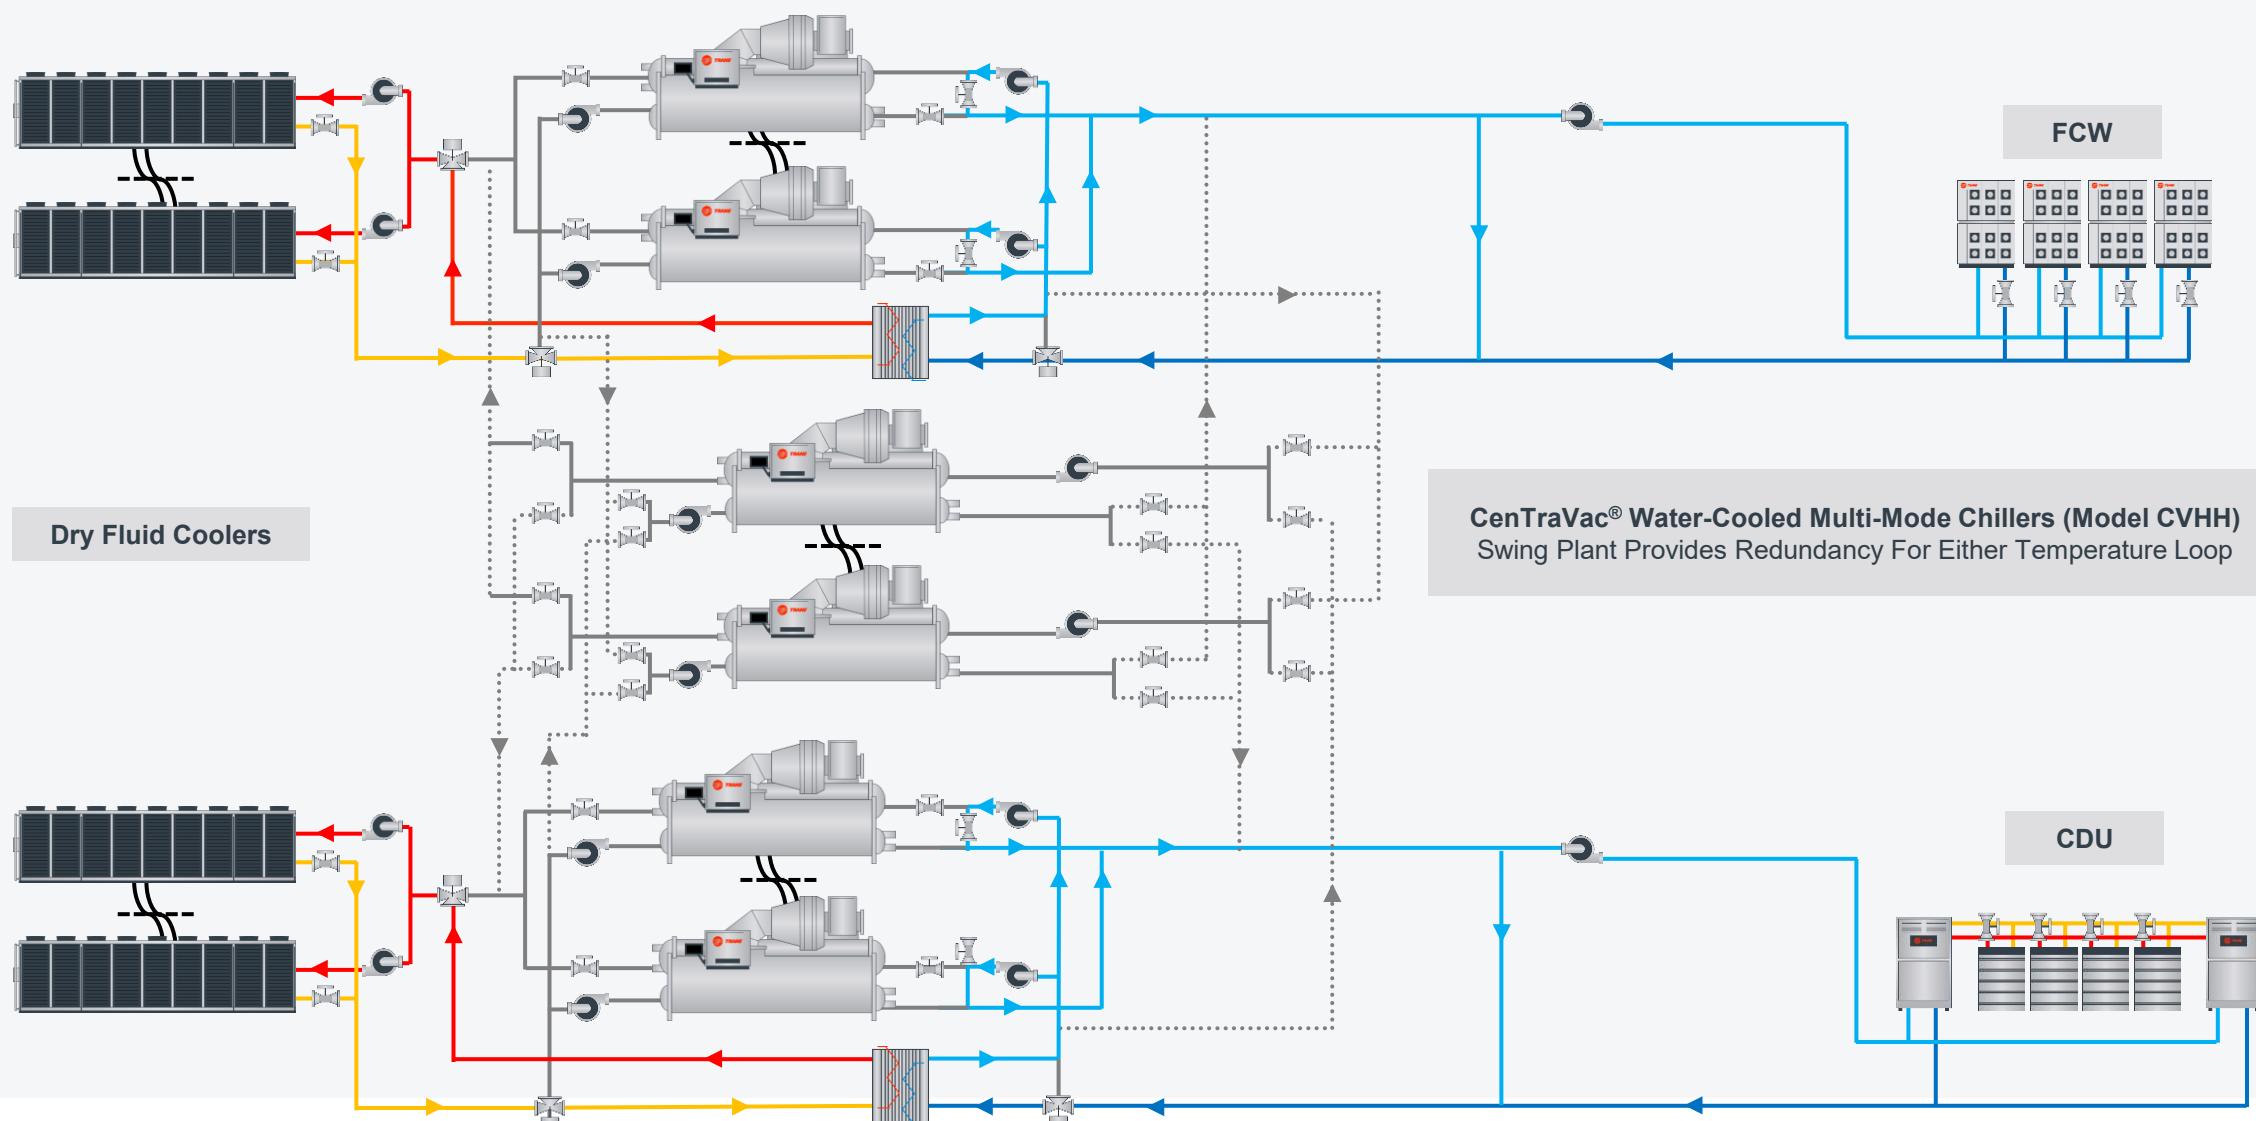

# → DESIGN OVERVIEW

## Customer Outcomes



### Reduce power use

- Optimizing for higher condenser water temperatures and increased delta T can further help reduce plant energy consumption
- Lower cooling power frees additional electrical capacity for compute operations, increasing token production and overall site profitability
- Advanced controls optimize chiller lift and pump energy to maintain best-in-class PUE



### Future-ready design

- Built to adapt as chip densities increase and cooling demands evolve
- Supports flexible ratios of liquid and air cooling
- Dual-mode chillers in the swing plant enable smooth rebalancing between cooling loops without adding new equipment



### Balanced total cost of ownership (TCO), redundancy and resiliency

- Swing chillers can be assigned to either high- or low-temperature loops, reducing the total number of chillers required
- Raising the condenser water temperature and increasing the delta T reduces the number of dry coolers required and lowers the overall cooling plant power consumption
- High-efficiency water-cooled design with dry coolers keeps both energy and water costs low — helping to improve ROI and sustainability metrics

# → SYSTEM BENEFITS


Water-cooled systems offer significant performance and sustainability advantages over air-cooled alternatives, delivering higher efficiency, low water use and helps to reduce environmental impact for large-scale AI data centers.

- Fewer chillers due to larger capacity per unit
- Improved efficiency — better Power Usage Effectiveness (PUE)
- Dry coolers eliminate water use –  
Water Usage Effectiveness (WUE) = 0
- R-1233zd refrigerant (GWP 1) cuts carbon impact
- Dedicated temperature loops maximize free-cooling hours






# KEY SYSTEM COMPONENTS

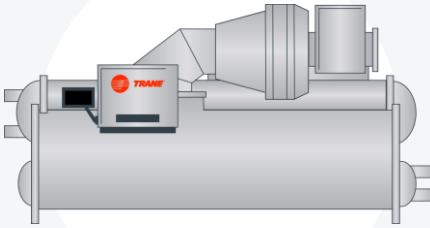

## Water-Cooled Chillers

Trane CenTraVac® chillers are engineered for data centers, operating efficiently at higher water temperatures to deliver reliable cooling and improved overall plant performance.



## Fan Coil Walls

Trane Fan Coil Walls provide higher capacity, efficient air cooling in the data hall, using medium chilled-water temperatures to deliver added capacity where air cooling is needed most.



## Dry Coolers

Dry coolers reject heat directly to ambient air using dry-bulb temperature, eliminating water use and achieving a WUE of zero. Trane works with leading manufacturers to assure each system is optimized for site conditions and climate.



## Coolant Distribution Units (CDUs)

Trane CDUs support the liquid-cooled portion of the data hall, separating facility and technical loops with a liquid-to-liquid heat exchanger for efficient, high-temperature cooling compatible with AI servers.



# KEY SYSTEM COMPONENTS

## CenTraVac® Water-Cooled Chillers Model CVHH

Design Characteristic	Requirements
Capacity Range	Up to 3,000 tons (11 MW)
Leaving Condenser Temp	Up to 68.3°C (155°F)
Facility Water Temperature Range	Up to 37.8°C (100°F)
Compressor	2-stage Centrifugal Compressor
Heat Rejection Options	Dry Cooler/High Lift Application 6-pipe Heat Recovery Options
Refrigerant	Low GWP: R-1233zd
Restart After Power Loss	43-76 Seconds Depending Upon Starter/Drive
Power Feed Requirement	2300V to 12 kV Starter and Drive Options





# KEY SYSTEM COMPONENTS

## Dry Cooler

Design Characteristic	Requirements
Capacity Range	1,500 tons (5 MW+)
Max Ambient Dry Bulb	62.8+°C (145+°F)
Fans	Variable Speed VFD or ECM Driven Fans
Power Feed Requirement	380-480, 3 ph, 50/60 Hz

Dry Cooler capacity and performance is dependent on local ambient extreme conditions.





# KEY SYSTEM COMPONENTS

## Fan Coil Wall

Design Characteristic	Requirements
Capacity Range	Up to 670 KW
Airflow Range	110K CFM+
Entering Air Temp	Up to 40°C (104°F)
Fan Options	ECM Direct Drive Fans
Additional Feature Options	Controls Teaming Application Pressure Independent Control Valve Automatic Transfer Switch
Filtration	2" or 4" Filters (MERV 8 or 11)
Harmonic Filtration	5% or Less of Total Demand Distortion
Power Draw	< 6% of Capacity Being Cooled in KW
Power Feed Requirement	415-480, 3 ph, 50/60 Hz





# KEY SYSTEM COMPONENTS

## Coolant Distribution Unit (CDU)

Design Characteristic	Requirements
<b>Capacity Range</b>	Up to 10 MW at 4°C (7.2°F) Approach
<b>Effectiveness</b>	>90% at 4°C (7.2°F) Approach
<b>Minimum Pressure Head</b>	40 PSID + dp Across CDU
<b>Design Secondary (PG 25) Supply Temp</b>	Up to 45°C (113°F)
<b>Design Facility Water Temperature</b>	Up to 41°C (105.8°F)
<b>Max Ambient Temperature Operation</b>	50°C (122°F)
<b>Additional Feature Options</b>	Scalable Solution Controls Teaming Application Pressure Independent Control Valve 316 Stainless Steel Plate Heat Exchanger Tripe-Redundant Sensors in the Header
<b>Secondary Side Filtration</b>	25-Micron Filtration
<b>Power Draw</b>	< 1% of Capacity Being Cooled in KW
<b>Power Feed Requirement</b>	380-480, 3 ph, 50/60 Hz





# OPTIMIZATION APPROACH

## Elevating Condenser Loop Temperature and Increasing Condenser Loop delta T

### Impact to Chiller Plant

Raising the condenser temperature of a chiller by 5.6°C (10°F) increases the compressor lift, which is defined as the difference between the leaving condenser temperature and the evaporator temperature. This higher lift requires the chiller compressor to do more work and consume more energy. However, operating at a higher lift allows for significant reductions in condenser water flow, decreasing the energy needed by condenser pumps and dry cooler fans. As a result, total system power consumption will decrease, even though chiller compressor energy usage increases, because the work shifts to more efficient components.

### Impact to Dry Cooler/Pumps

Raising the condensing leaving water temperature increases the temperature differential between the heat source (condensing fluid) and the heat sink (ambient air). This greater temperature differential allows each dry cooler to provide more capacity compared to a smaller differential. As a result, fewer dry coolers may be required, or the existing number of dry coolers may operate at a more efficient point, or some combination of the two. A higher condenser water delta T of 2.2°C (4°F) results in lower flow rates, which reduces pumping power. However, the reduced flow rate may also decrease capacity, potentially requiring additional dry cooler units.

Peak Power Impact	
Chiller Power	7%
Dry Cooler Fan Power	30%
Condenser Pump Power	51%
<b>Cooling Plant System Power</b>	<b>9% </b>

Optimization 1 (Reduced Dry Cooler Quantity):	
Free Cooling Operating Envelope	Reduced
Dry Cooler Footprint	30%
Optimization 2 (Same Dry Cooler Quantity):	
Free Cooling Operating Envelope	Unchanged
Dry Cooler Footprint	Unchanged




# BEST PRACTICES

## Decoupled Loops

Separating the production (chiller) and distribution loops allows each to operate at its optimal temperature difference ( $\Delta T$ ), helping to improve efficiency and control while reducing pump energy. The decoupled design also simplifies system staging and enhances overall plant stability.

- Production and distribution loops operate independently to optimize flow and  $\Delta T$
- Pump energy consumption is reduced under varying load conditions
- Flow through the decoupler indicates plant balance and triggers chiller staging
- The design provides smoother operation and faster response to load changes

## Typical Decoupled Plant

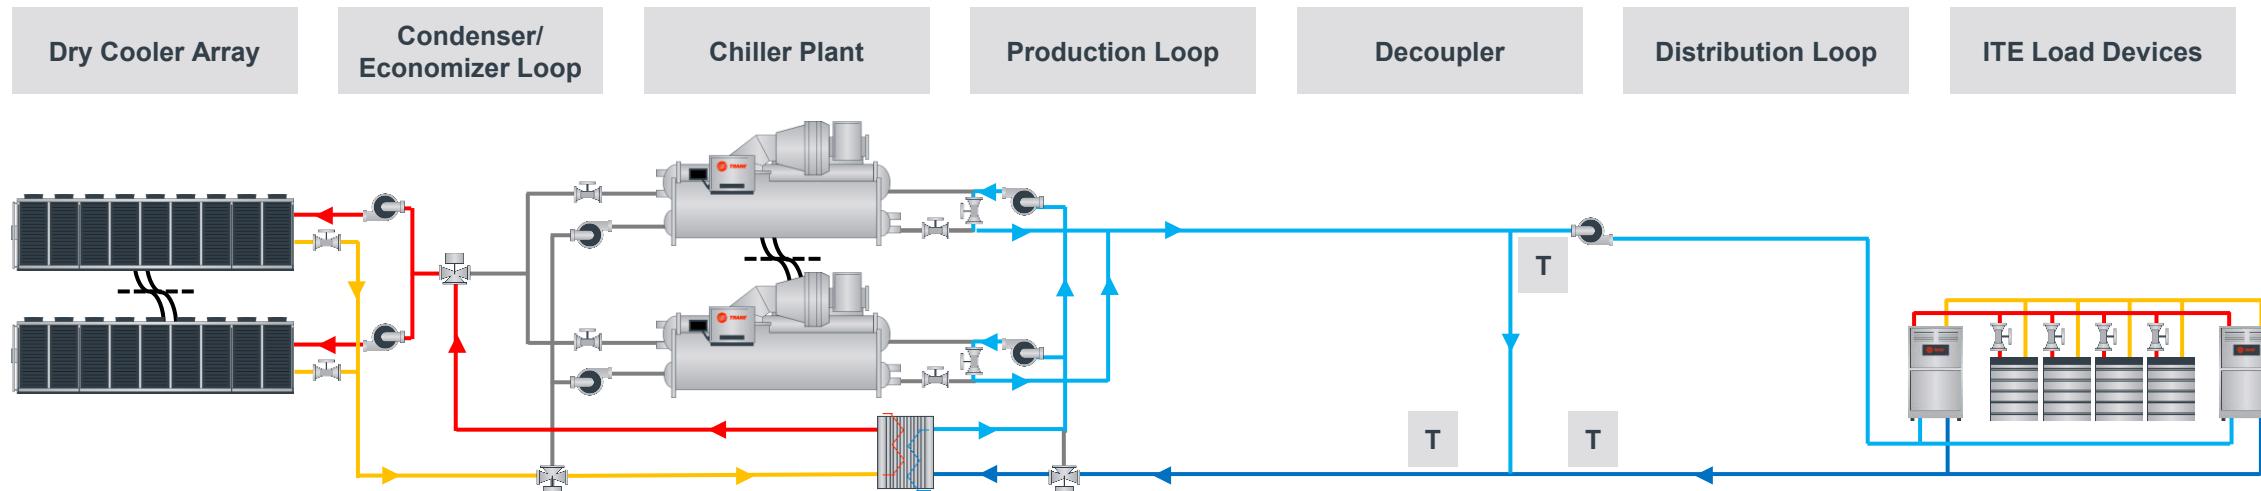



# BEST PRACTICES

## Redundancy

### Air- vs. water-cooled chillers

Redundancy needs vary by system type. Air-cooled chillers are dual circuit, while water-cooled (CVHH) units have a single circuit. Air-cooled units contain more components and are more sensitive to airflow loss (reduced airflow can cause high-pressure shutdowns), while dry coolers and water-cooled chillers can continue operating at reduced capacity.

### Single vs. dual compressor

Trane CVHH chillers use a single compressor, while CDHH units feature two for added reliability. Dual-compressor chillers offer built-in redundancy, maintaining operation during maintenance or partial failures.

### Swing chiller plant

In most AI data centers, liquid cooling carries the majority load and air cooling handles the minority. Because air coils require colder supply water, the plant must accommodate both temperature needs efficiently.

- **Single-temperature plant**

A single-temperature system supplies colder water for air cooling and mixes part of it to a higher temperature for liquid cooling. While simple, this adds unnecessary lift to the liquid loop and increases energy use.

- **Dual-temperature plant**


A dual-temperature system uses dedicated high- and low-temperature loops, eliminating the efficiency penalty of added lift. The high-temperature loop supports more hours of free cooling, while both loops maintain redundancy through shared or swing chillers.

# **BEST PRACTICES**

# Redundancy

## Dual-temperature chiller plant, dedicated low and high temperature chillers

A dual-temperature chiller plant with dedicated low- and high-temperature chillers uses separate equipment for each loop, providing full redundancy within both systems. This configuration maintains independent operation and ensures uninterrupted cooling even if one loop or chiller set is offline for maintenance or repair.

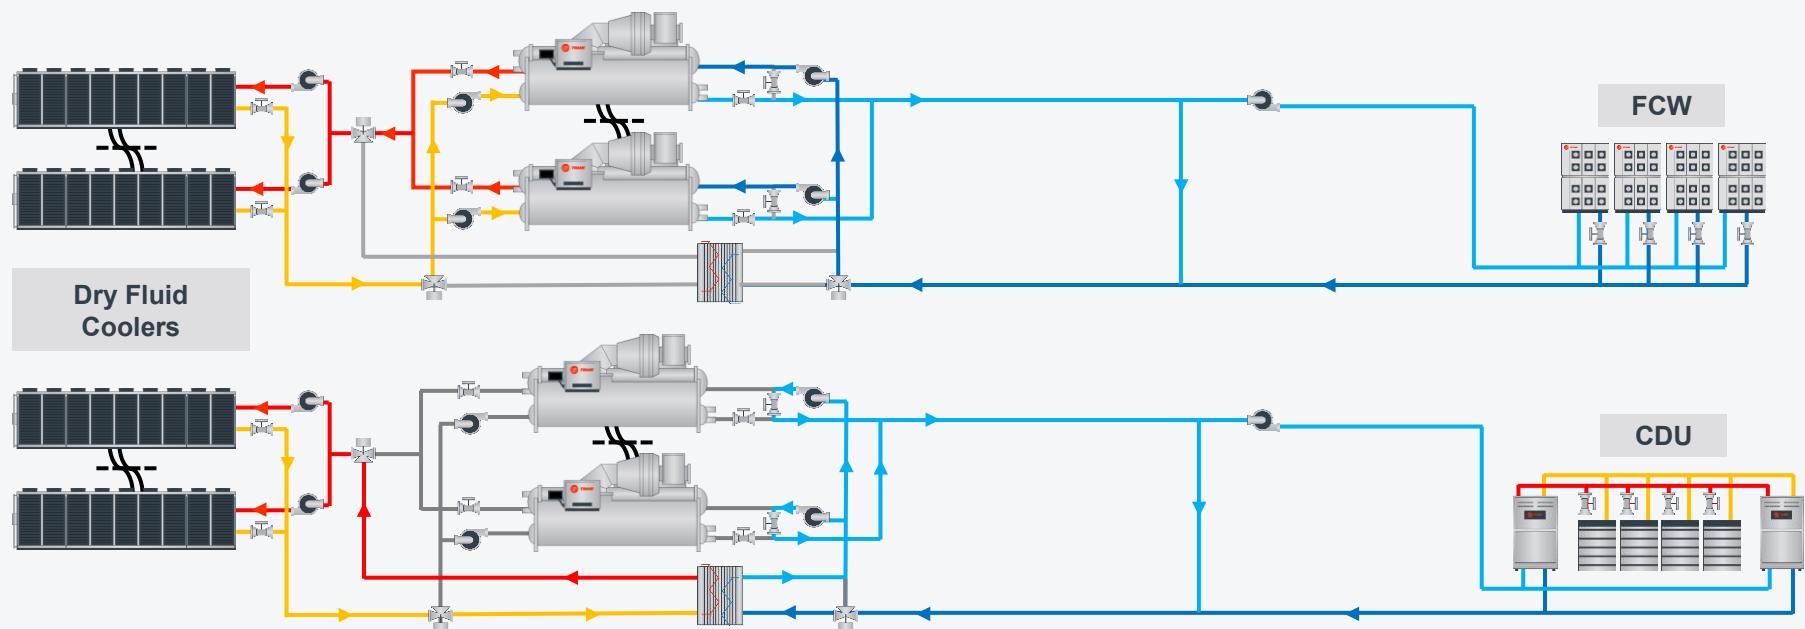


# BEST PRACTICES

## Redundancy

### Dual-temperature plant with swing chillers

A dual-temperature chiller plant with swing chillers allows redundant units to be flexibly assigned to either the high- or low-temperature loop, reducing the total number of chillers needed when full dual-loop redundancy isn't required.

The swing chillers are selected for multiple modes of operation to ensure they can serve either loop.

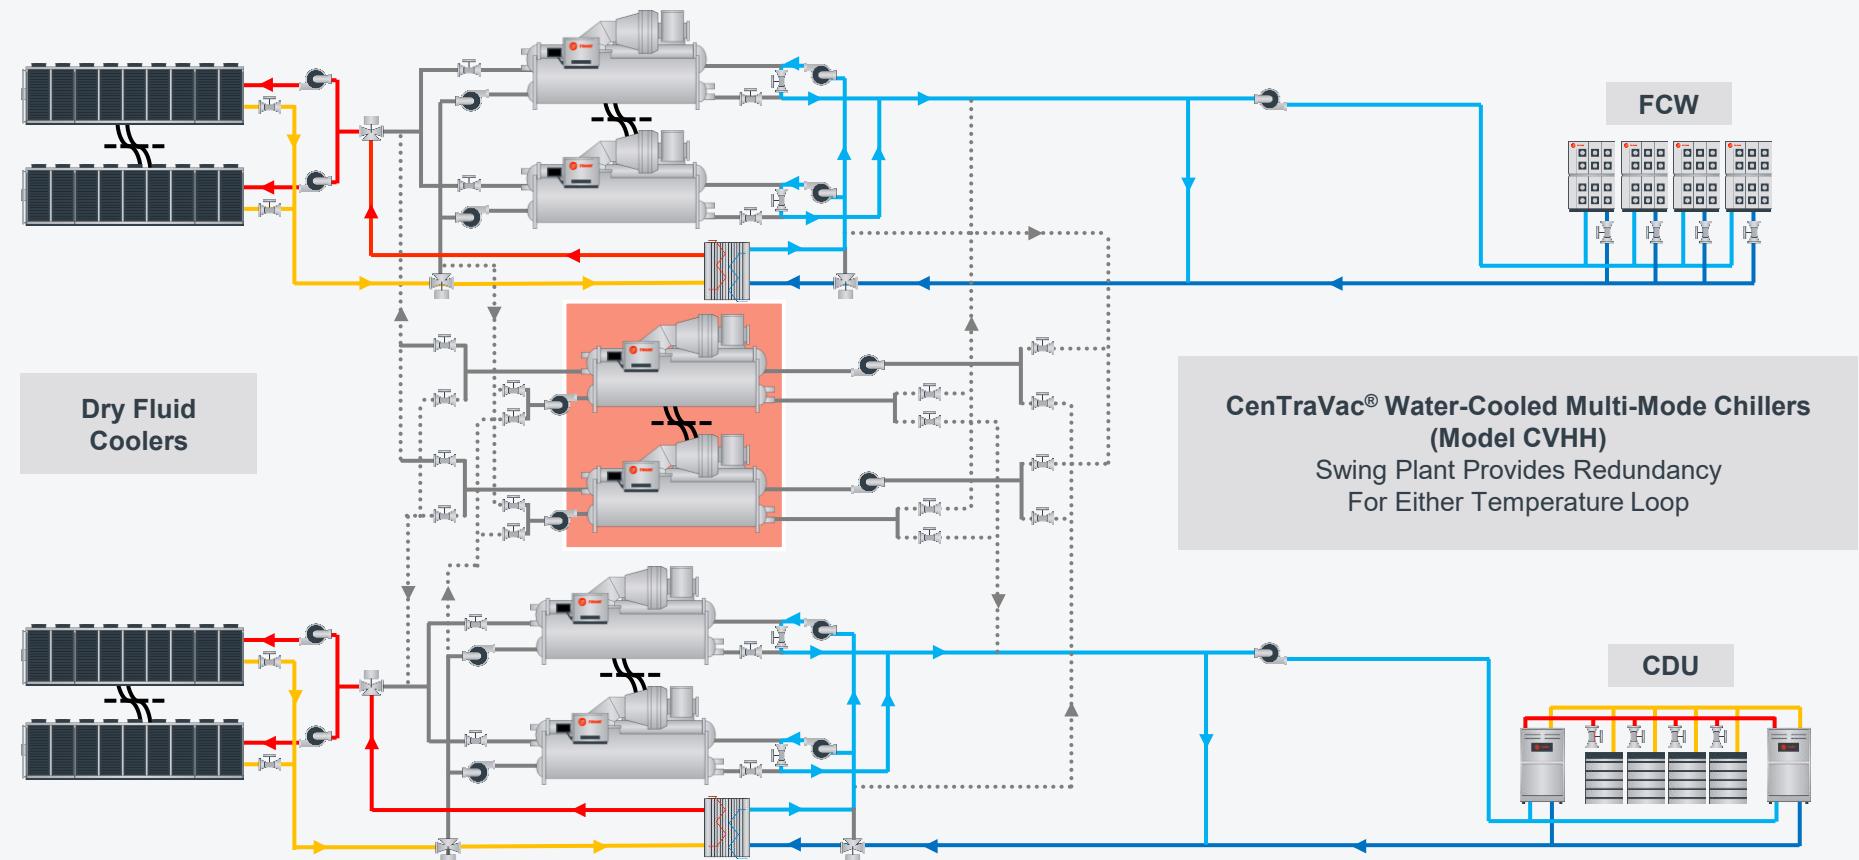


## BEST PRACTICES

## Block Sizing

Designing a single chiller plant for a 1 GW scale data center is not practical — the pipe, fitting, valve and pump sizes required for such capacity would be prohibitively large. A more effective approach is to divide the load into 102.4 MW partitions, typically served by 48-inch piping depending on system selections.

- Each partition is served by 10 - 9.6 MW CDU pods and 1 - 6.4MW CDU pod
- Each CDU has N+1 Redundancy
- Each totals 102.4 MW and includes 512 (200-kW) racks.
- 9.6 MW Deployment : 4 rows, 12 \*200-kW racks per row
- 6.4 Deployment: 4 rows, 8 \*200-kW racks per row
- Remaining site power reserved for airside cooling loop, additional IT loads and other site needs

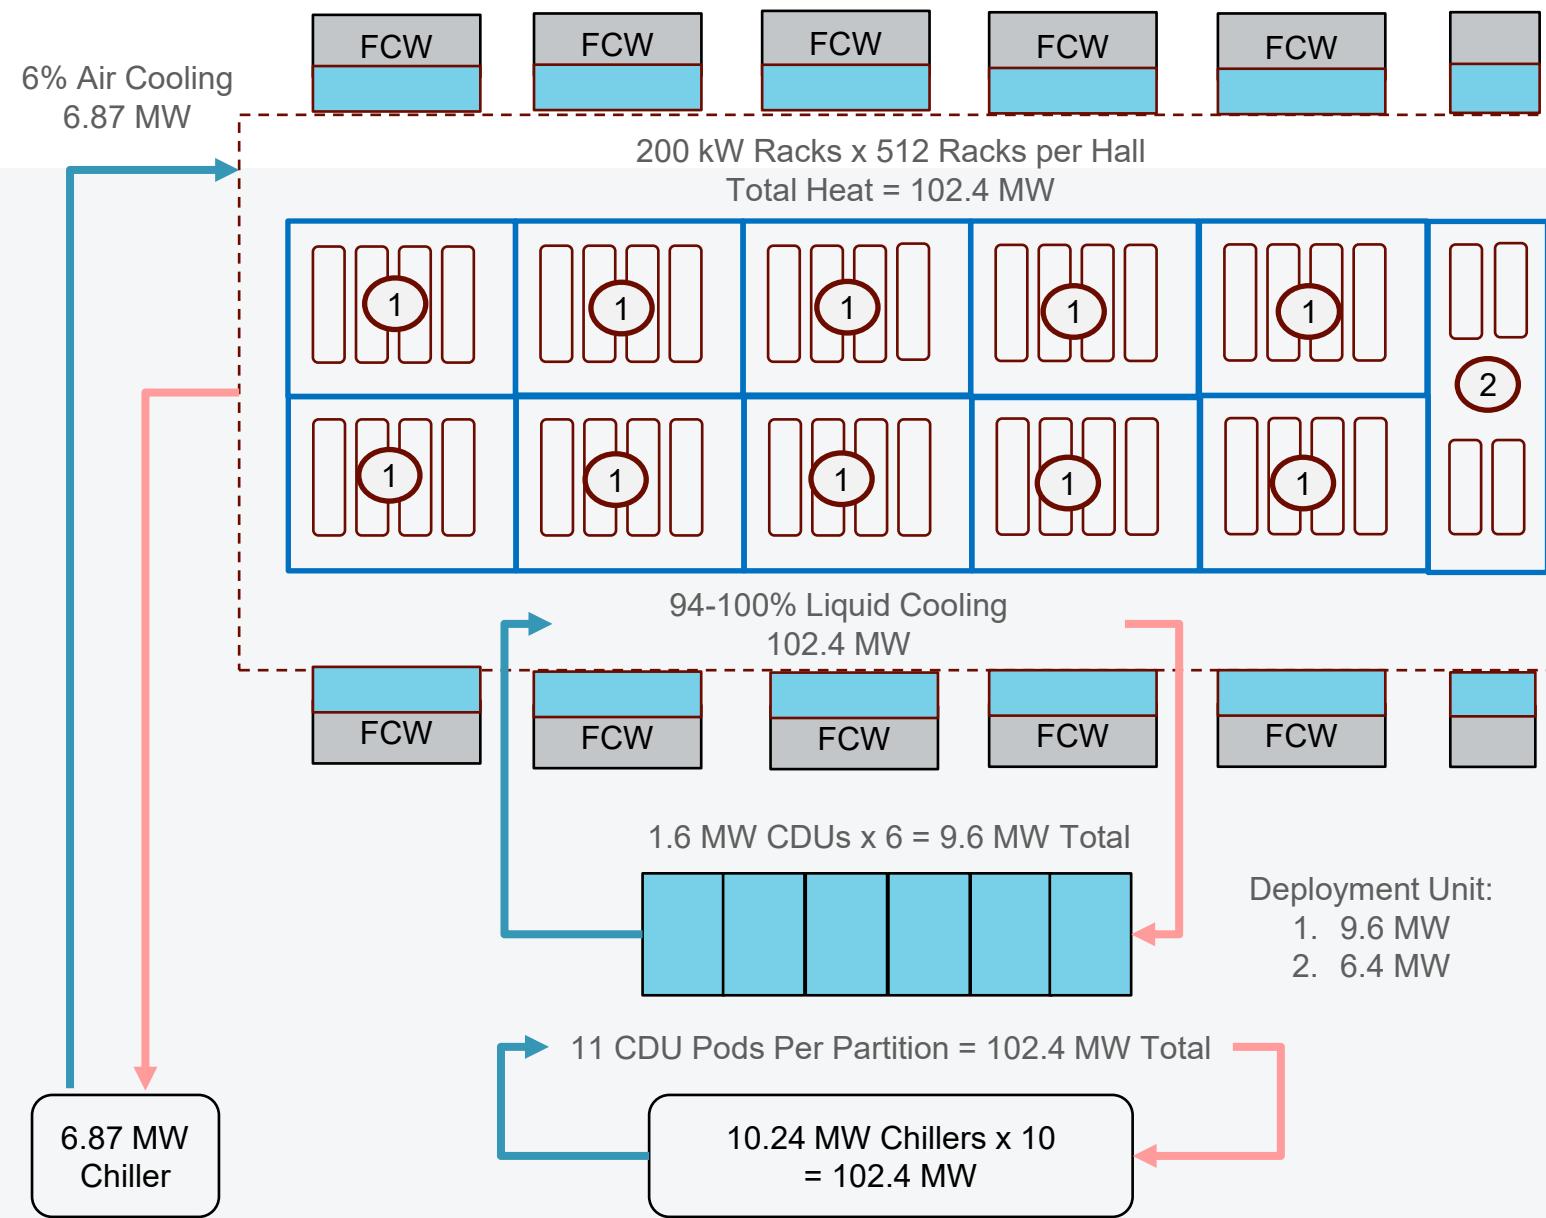



# BEST PRACTICES

## Free Cooling

Cooling loads are typically designed for the maximum expected demand, or “design point.” In practice, both the cooling load and outdoor ambient temperature fluctuate, creating opportunities for “free cooling” when conditions allow. This reference design uses dry coolers and a plate-and-frame heat exchanger to provide free cooling under favorable ambient temperatures.

Free-cooling capacity depends on the difference between the fluid temperature and outdoor dry-bulb temperature. For this reference design, operation can be grouped into three modes.

### Mode 1: Free Cooling

Outdoor temperature is low enough to provide full cooling without mechanical assistance.

### Mode 2: Hybrid Cooling

Outdoor temperature is lower than return temperature; exceeds temperature to provide full cooling capacity

### Mode 3: Mechanical Cooling

Outdoor temperature exceeds fluid return temperature — free cooling is bypassed.



# BEST PRACTICES

## Freeze Protection

Outdoor equipment such as dry coolers and exposed piping is at risk of freezing when ambient temperatures drop below the fluid's freeze point. Protection can be achieved by selecting a suitable fluid or by adding heat to maintain temperature above freezing.

- Select a fluid with a freeze point below expected operating conditions
- Add heat to keep local temperatures above the fluid's freeze point

Glycol solutions (propylene or ethylene) have a freeze point, where crystals begin to form, and a burst point, where expansion can cause damage. Proper concentration ensures the fluid remains pumpable and prevents freezing under site conditions.

If water is used, heat must be added to maintain temperature above freezing — especially in heat-rejection devices like dry coolers. The required heat depends on ambient conditions, water volume, and insulation quality.

If glycol is undesirable in the full loop, install isolation heat exchangers and local pumps to confine glycol to small closed loops while maintaining protection for any connected water lines.


# BEST PRACTICES

## Thermal Energy Storage

Thermal storage can be integrated into the chiller plant in several ways, with tank location determined by system needs. In general, the recommended location for the tank is in the decoupler line.

- **Tank on return side.** When placed on the return side, the tank buffers large temperature swings in water returning to the chillers during rapid load changes. Maintaining stable return temperature helps chillers deliver consistent leaving-water temperature.
- **Tank in the decoupler line.** Locating the tank in the decoupler line includes all the benefits noted above. This location also allows it to act as a thermal battery — charging when production exceeds demand and discharging when demand is higher. This cycle can repeat throughout the day and be optimized by system controls.

### Thermal storage tank in the decoupler pipe

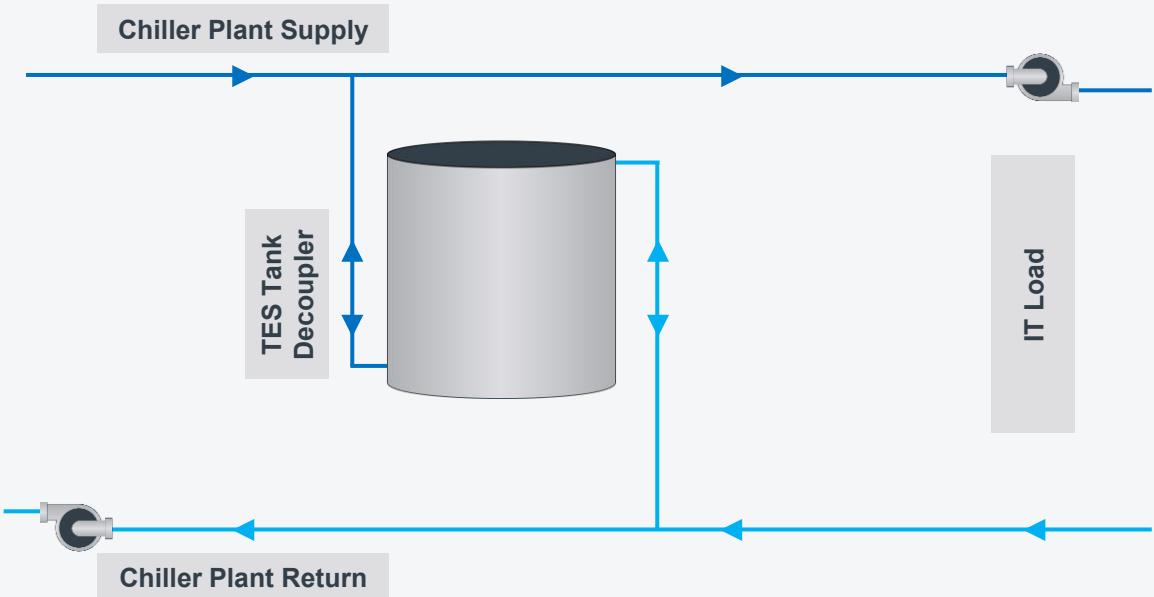

# → SYSTEM CONTROLS

Effective controls are critical to chiller plant performance and reliability. Trane's data center–specific control platform promotes efficiency, uptime and responsiveness by integrating all major components — chillers, dry coolers, pumps, valves, CDUs and fan coil walls — into one coordinated system.



## SYSTEM CONTROLS


### Reference Diagram

#### System Control


Tracer® is the single, powerful thermal management control system that simplifies operations by managing chiller rotation, staging and sequencing with built-in tools that ensure reliable performance and unlock data-driven capabilities.

#### AI Enhancements

Take your system optimization further with our AI-driven efficiency powerhouse. **Trane Autonomous Control** combines decades of building performance expertise with real-time data to drive continuous improvements in your thermal management system — finding every watt that can be optimized.

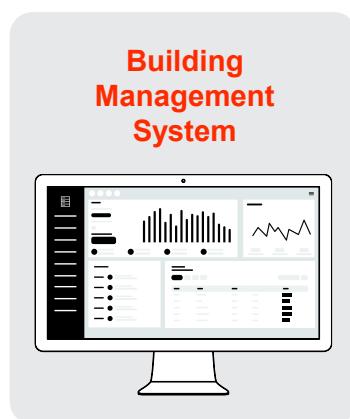

#### Trane Thermal Management System

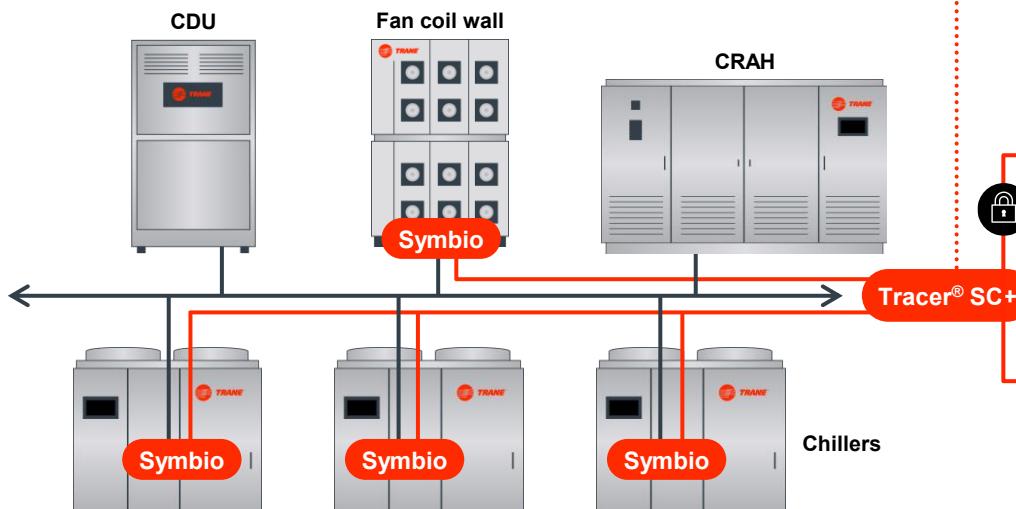

#### Digital Portal

##### Trane® Connect™

- Secure connectivity
- Remote service
- Analytics and diagnostics

##### Tracer® Synchrony®

- Chiller plant control
- Optimization strategies
- Equipment monitoring

#### Insights + Optimization

When power access is in question, your thermal management system must run at peak efficiency — because every kilowatt saved on cooling means more racks online. **Trane Intelligent Services** pulls data from your entire system to deliver actionable energy-saving strategies.

#### Equipment Connectivity

**Symbio® equipment controls** capture and translate a broad range of equipment-based points into the Tracer SC+, providing the basis for data-driven service and optimization strategies.

#### Predictive Maintenance

With your permission, we can securely connect to your equipment controls or Tracer SC+ to enable **Connected Mechanical Service**. By monitoring trend data and performance metrics, we can help identify emerging issues sooner, so your team or our service technicians can take the right action before failure or downtime occurs. When you need us on-site to address issues, **Trane Service Agreements** and **local technicians** are there when you need us.



## TRANE SERVICE

As data centers expand in size and complexity, the need for dependable, efficient cooling grows with them. Trane's thermal management services are designed to meet these evolving demands — providing scalable, responsive support that adapts to changing loads, tighter schedules and zero-tolerance uptime requirements.

- Embedded expertise ensures reliable operation from design through expansion and refresh
- Proactive planning helps reduce risk and downtime
- Connected insights help optimize capacity and efficiency across the lifecycle





# TRANE RENTAL SERVICES

Need unrivaled temporary thermal management and power solutions for your data center? Trust Trane Rental Services for:

- **Level 2, 3, and 4 commissioning services**, including line flushes and load bank testing
- **Expansion and retrofits** for new chip designs
- **Planned maintenance, emergency response, and redundancy** to protect SLAs
- Overcoming **new equipment lead times** to speed up new facility launches

As one of North America's largest OEM HVAC rental companies, Trane Rental Services leads the market. Our highly trained staff, rapid emergency response, and unmatched expertise are supported by 150 locations, 230 parts centers, and 2,600 technicians. Choose Trane Rental Services for reliable, expert solutions.



# → DESIGN RESOURCES

Trane provides a complete suite of resources to support the design of high-performance thermal management systems for data centers.

- All mechanical components are selected for site-specific conditions, with detailed submittal packages available
- System control sequences and operating modes can be customized for any chiller plant configuration
- TRACE™ modeling tools evaluate annual energy performance and efficiency
- Application guides and Trane experts are available to assist with design, optimization and implementation


**Reach out to Trane today for more information.**





# HELPFUL LINKS

**Trane BIM and Selection Tools →**

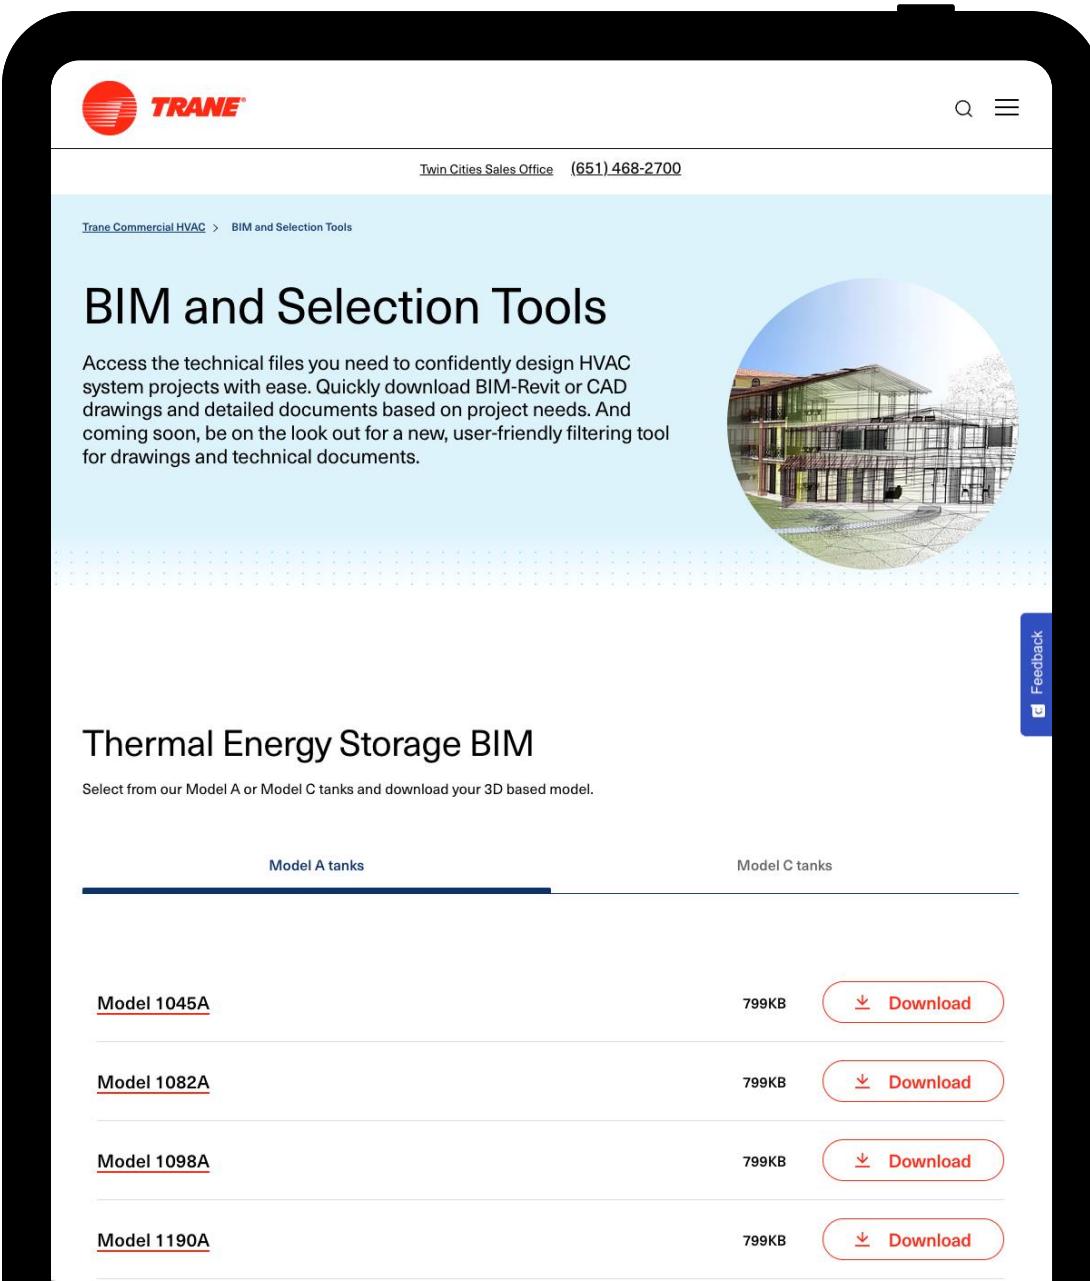

The image shows a smartphone displaying the Trane BIM and Selection Tools website. The website has a red header with the Trane logo. The main content area features a large image of a modern building with a glass facade and a green roof. The page title is "BIM and Selection Tools". Below the title, there is a paragraph of text: "Access the technical files you need to confidently design HVAC system projects with ease. Quickly download BIM-Revit or CAD drawings and detailed documents based on project needs. And coming soon, be on the look out for a new, user-friendly filtering tool for drawings and technical documents." A "Feedback" button is visible on the right side of the screen.

## BIM and Selection Tools

Access the technical files you need to confidently design HVAC system projects with ease. Quickly download BIM-Revit or CAD drawings and detailed documents based on project needs. And coming soon, be on the look out for a new, user-friendly filtering tool for drawings and technical documents.

### Thermal Energy Storage BIM

Select from our Model A or Model C tanks and download your 3D based model.

Model A tanks	Model C tanks
<a href="#">Model 1045A</a>	799KB <a href="#">Download</a>
<a href="#">Model 1082A</a>	799KB <a href="#">Download</a>
<a href="#">Model 1098A</a>	799KB <a href="#">Download</a>
<a href="#">Model 1190A</a>	799KB <a href="#">Download</a>

# Trane.com/DataCenters

*This is for informational purposes only and does not constitute professional advice. Trane believes the facts and suggestions presented here to be accurate; however, final design and application decisions are your responsibility. Trane disclaims any responsibility for actions taken on the material presented. This presentation is protected by U.S. and international copyright laws. Reproduction, distribution, display, and use of the presentation without written permission of Trane is prohibited.*



Trane – by Trane Technologies (NYSE: TT), a global climate innovator – creates comfortable, energy efficient indoor environments through a broad portfolio of heating, ventilating and air conditioning systems and controls, services, parts and supply. For more information, please visit [trane.com](http://trane.com) or [tranetechnologies.com](http://tranetechnologies.com).

All trademarks referenced in this document are the trademarks of their respective owners. © 2025 Trane. All Rights Reserved.

DC-PRR003A-EN  
01/23/2026