



**TRANE®**

TRANE  
TECHNOLOGIES

REFERENCE DESIGN #501

# HIGH-EFFICIENCY COOLING FOR THE 1 GW AI FACTORY

A scalable reference design that cuts  
energy, water use and cost.





# INTRODUCTION

Artificial intelligence is driving massive growth in data center demand — and advanced cooling is critical to keep innovation running. Trane leads the way with proven thermal management solutions for AI factories and data centers of all sizes.

## **This reference design provides:**

- ✓ A 1 GW cooling blueprint for AI factory applications
- ✓ Integrated air- and liquid-cooling configurations for NVIDIA racks
- ✓ Guidance on CDUs, fan coil walls, chillers, dry coolers, pumps and facility piping
- ✓ A foundation for mechanical design that complements electrical and controls systems





# DESIGN OVERVIEW

## Temperature and Flow Rates

This table summarizes temperature and flow rate requirements for the water-cooled chillers in this reference design. These values represent an AI factory installed in Albuquerque, NM and can be adjusted for specific applications.

Technical Loop Supply Temperature: 30°C (86°F)

Technical Loop Return Temperature: 40°C (104°F)

Fan Coil Wall Supply Air Temperature: 27°C (80.6°F)

|                                        | Medium Temperature<br>(Airside) | High Temperature<br>(Liquid Direct to Chip) |
|----------------------------------------|---------------------------------|---------------------------------------------|
| Total Block Load                       | 13.74MW (3,906T)                | 102.4MW (29,120T)                           |
| Load Requirement/Chiller               | 6.87MW (1,953T)                 | 10.24MW (2,912T)                            |
| Evaporator Flow Rate/Chiller           | 9,978 LPM (2,635.9 GPM)         | 14,878 LPM (3,930.4 GPM)                    |
| Facility Loop Temperature (High)       | 32°C (89.6°F)                   | 36°C (96.8°F)                               |
| Facility Loop Temperature (Low)        | 22°C (71.6°F)                   | 26°C (78.8°F)                               |
| Facility Loop Fluid                    | Water                           | Water                                       |
| Condenser Flow Rate/Chiller            | 14,771 LPM (3,902.5 GPM)        | 19,992 LPM (5,821.3 GPM)                    |
| Heat Rejection Loop Temperature (High) | 53.3°C (128°F)                  | 53.3°C (128°F)                              |
| Heat Rejection Loop Temperature (Low)  | 45.6°C (114°F)                  | 45.6°C (114°F)                              |
| Heat Rejection Loop Fluid              | Water                           | Water                                       |
| Max Ambient (Albuquerque, NM)          | 40°C (104°F)                    |                                             |
| Elevation (Albuquerque, NM)            | 1,619m (5,312')                 |                                             |


DESIGN OVERVIEW

Reference Diagram

✓ 1 GW mechanical cooling  
blueprint for AI factories

✓ Integrates air- and liquid-  
cooling systems

✓ Modular structure for  
scalability and serviceability

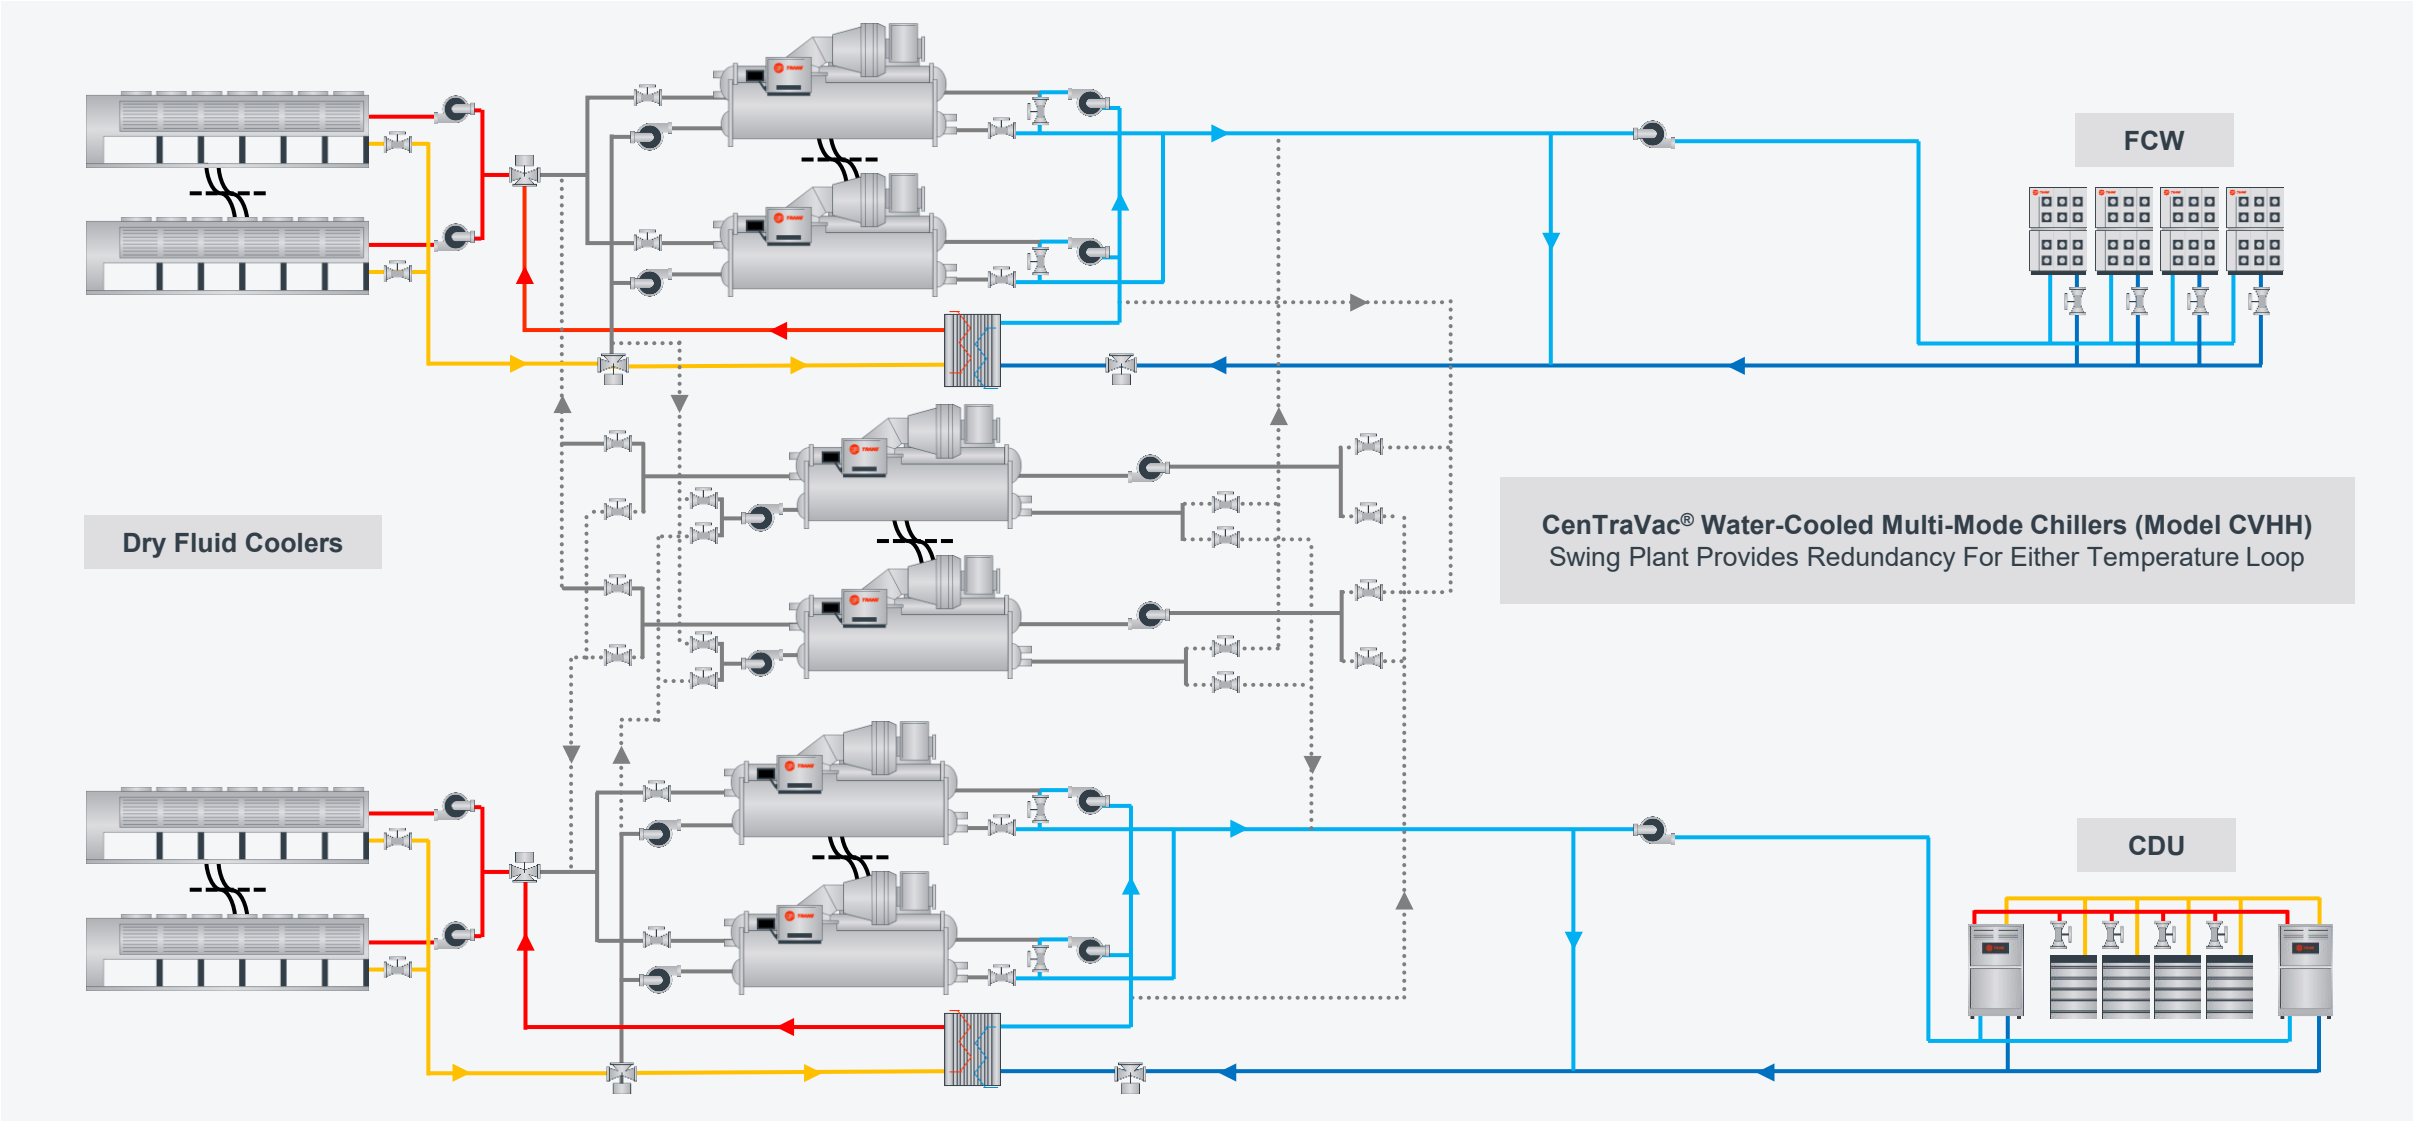



# → DESIGN OVERVIEW

## Customer Outcomes



### Reduce power use

- High-efficiency Trane water-cooled chillers minimize plant energy consumption
- Lower cooling power frees additional electrical capacity for compute operations, increasing token production and overall site profitability
- Advanced controls optimize chiller lift and pump energy to maintain best-in-class PUE



### Future-ready design

- Built to adapt as chip densities increase and cooling demands evolve
- Supports flexible ratios of liquid and air cooling
- Shared infrastructure enables smooth rebalancing between cooling modes without adding new equipment



### Balanced total cost of ownership (TCO), redundancy and resiliency

- Swing chillers can be assigned to either high- or low-temperature loops, reducing the total number of chillers required
- Fewer units mean lower capital cost while maintaining redundancy and uptime
- High-efficiency water-cooled design with dry coolers keeps both energy and water costs low — improving ROI and sustainability metrics


# → **SYSTEM BENEFITS**

Water-cooled systems offer significant performance and sustainability advantages over air-cooled alternatives, delivering higher efficiency, lower water use and reduced environmental impact for large-scale AI data centers.

- Fewer chillers due to larger capacity per unit
- Improved efficiency — better Power Usage Effectiveness (PUE)
- Dry coolers eliminate water use —  
Water Usage Effectiveness (WUE) = 0
- R-1233zd refrigerant (GWP 1) cuts carbon impact
- Dedicated temperature loops maximize free-cooling hours




# → KEY SYSTEM COMPONENTS

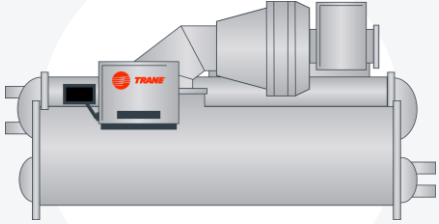


## Water-Cooled Chillers

Trane CenTraVac® chillers are engineered for data centers, operating efficiently at higher water temperatures to deliver reliable cooling and improved overall plant performance.



## Fan Coil Walls

Trane Fan Coil Walls provide higher capacity, efficient air cooling in the data hall, using medium chilled-water temperatures to deliver added capacity where air cooling is needed most.



## Dry Coolers

Dry coolers reject heat directly to ambient air using dry-bulb temperature, eliminating water use and achieving a WUE of zero. Trane works with leading manufacturers to assure each system is optimized for site conditions and climate.



## Coolant Distribution Units (CDUs)

Trane CDUs support the liquid-cooled portion of the data hall, separating facility and technical loops with a liquid-to-liquid heat exchanger for efficient, high-temperature cooling compatible with AI servers.

# → KEY SYSTEM COMPONENTS

## CenTraVac® Water-Cooled Chillers Model CVHH

| Design Characteristic            | Requirements                                                     |
|----------------------------------|------------------------------------------------------------------|
| Capacity Range                   | Up to 3,000 tons (11 MW)                                         |
| Leaving Condenser Temp           | Up to 68.3°C (155°F)                                             |
| Facility Water Temperature Range | Up to 37.8°C (100°F)                                             |
| Compressor                       | Two 2-stage Centrifugal Compressor                               |
| Heat Rejection Options           | Dry Cooler/High Lift Application<br>6-pipe Heat Recovery Options |
| Refrigerant                      | Low GWP: R-1233zd                                                |
| Restart After Power Loss         | 43-76 Seconds Depending Upon<br>Starter/Drive                    |
| Power Feed Requirement           | 400V to 12 kVA<br>Starter and Drive Options                      |





# → KEY SYSTEM COMPONENTS

## Dry Cooler

| Design Characteristic  | Requirements                          |
|------------------------|---------------------------------------|
| Capacity Range         | 1,500 tons (5 MW+)                    |
| Max Ambient Dry Bulb   | 62.8+°C (145+°F)                      |
| Fans                   | Variable Speed VFD or ECM Driven Fans |
| Power Feed Requirement | 380-480, 3 ph, 50/60 Hz               |

Dry Cooler capacity and performance is dependent on local ambient extreme conditions.

\* This is based on Albuquerque, New Mexico design conditions



# → KEY SYSTEM COMPONENTS

## Fan Coil Wall

| Design Characteristic      | Requirements                                                                                    |
|----------------------------|-------------------------------------------------------------------------------------------------|
| Capacity Range             | Up to 670 KW                                                                                    |
| Airflow Range              | 110K CFM+                                                                                       |
| Entering Air Temp          | Up to 40°C (104°F)                                                                              |
| Fan Options                | ECM Direct Drive Fans                                                                           |
| Additional Feature Options | Controls Teaming Application<br>Pressure Independent Control Valve<br>Automatic Transfer Switch |
| Filtration                 | 2" or 4" Filters (MERV 8 or 11)                                                                 |
| Harmonic Filtration        | 5% or Less of Total Demand Distortion                                                           |
| Power Draw                 | < 6% of Capacity Being Cooled in KW                                                             |
| Power Feed Requirement     | 415-480, 3 ph, 50/60 Hz                                                                         |



# → KEY SYSTEM COMPONENTS

## Coolant Distribution Unit (CDU)

| Design Characteristic                | Requirements                                                                                                                                                                 |
|--------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Capacity Range                       | Up to 10 MW at 4°C (39.2°F) Approach                                                                                                                                         |
| Effectiveness                        | >90% at 4°C (39.2°F) Approach                                                                                                                                                |
| Minimum Pressure Head                | 40 PSID + dp Across CDU                                                                                                                                                      |
| Design Secondary (PG 25) Supply Temp | Up to 39°C (102.2°F)                                                                                                                                                         |
| Design Facility Water Temperature    | Up to 35°C (95°F)                                                                                                                                                            |
| Max Ambient Temperature Operation    | 50°C (122°F)                                                                                                                                                                 |
| Additional Feature Options           | Scalable Solution<br>Controls Teaming Application<br>Pressure Independent Control Valve<br>316 Stainless Steel Plate Heat Exchanger<br>Tripe-Redundant Sensors in the Header |
| Secondary Side Filtration            | 25-Micron Filtration                                                                                                                                                         |
| Power Draw                           | < 1% of Capacity Being Cooled in KW                                                                                                                                          |
| Power Feed Requirement               | 380-480, 3 ph, 50/60 Hz                                                                                                                                                      |




# → BEST PRACTICES

## Decoupled Loops

Separating the production (chiller) and distribution loops allows each to operate at its optimal temperature difference ( $\Delta T$ ), improving efficiency and control while reducing pump energy. The decoupled design also simplifies system staging and enhances overall plant stability.

- Production and distribution loops operate independently to optimize flow and  $\Delta T$
- Pump energy consumption is reduced under varying load conditions
- Flow through the decoupler indicates plant balance and triggers chiller staging
- The design provides smoother operation and faster response to load changes

### Typical Decoupled Plant

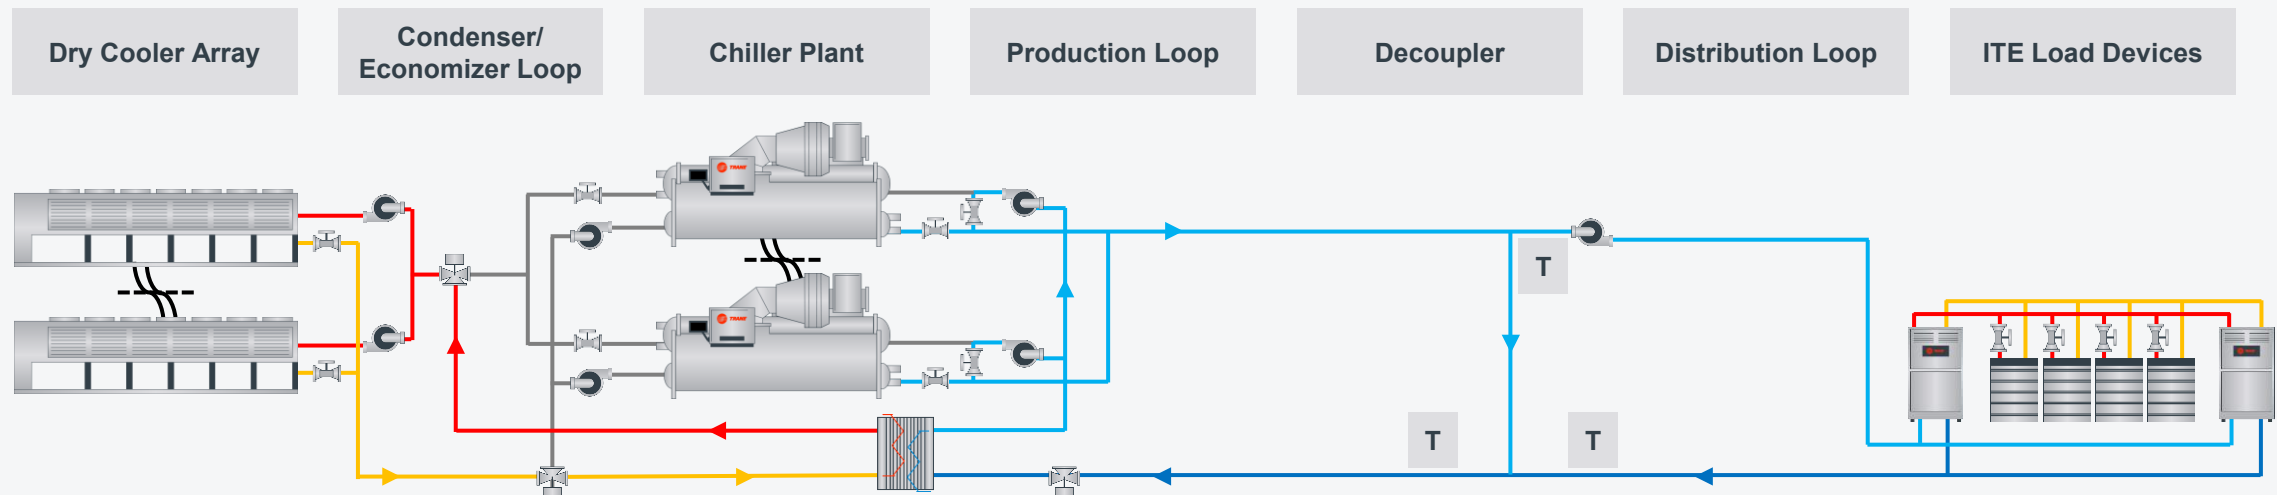

# → BEST PRACTICES

## Redundancy

### Air- vs. water-cooled chillers

Redundancy needs vary by system type. Air-cooled chillers are dual circuit, while water-cooled (CVHH) units have a single circuit. Air-cooled units contain more components and are more sensitive to airflow loss (reduced airflow can cause high-pressure shutdowns), while dry coolers and water-cooled chillers can continue operating at reduced capacity.

### Single vs. dual compressor

Trane CVHH chillers use a single compressor, while CDHH units feature two for added reliability. Dual-compressor chillers offer built-in redundancy, maintaining operation during maintenance or partial failures.

### Swing chiller plant

In most AI data centers, liquid cooling carries the majority load and air cooling handles the minority. Because air coils require colder supply water, the plant must accommodate both temperature needs efficiently.

- **Single-temperature plant**

A single-temperature system supplies colder water for air cooling and mixes part of it to a higher temperature for liquid cooling. While simple, this adds unnecessary lift to the liquid loop and increases energy use.

- **Dual-temperature plant**

A dual-temperature system uses dedicated high- and low-temperature loops, eliminating the efficiency penalty of added lift. The high-temperature loop supports more hours of free cooling, while both loops maintain redundancy through shared or swing chillers.




# → BEST PRACTICES

## Redundancy

### Dual-temperature chiller plant, dedicated low and high temperature chillers

A dual-temperature chiller plant with dedicated low- and high-temperature chillers uses separate equipment for each loop, providing full redundancy within both systems. This configuration maintains independent operation and ensures uninterrupted cooling even if one loop or chiller set is offline for maintenance or repair.

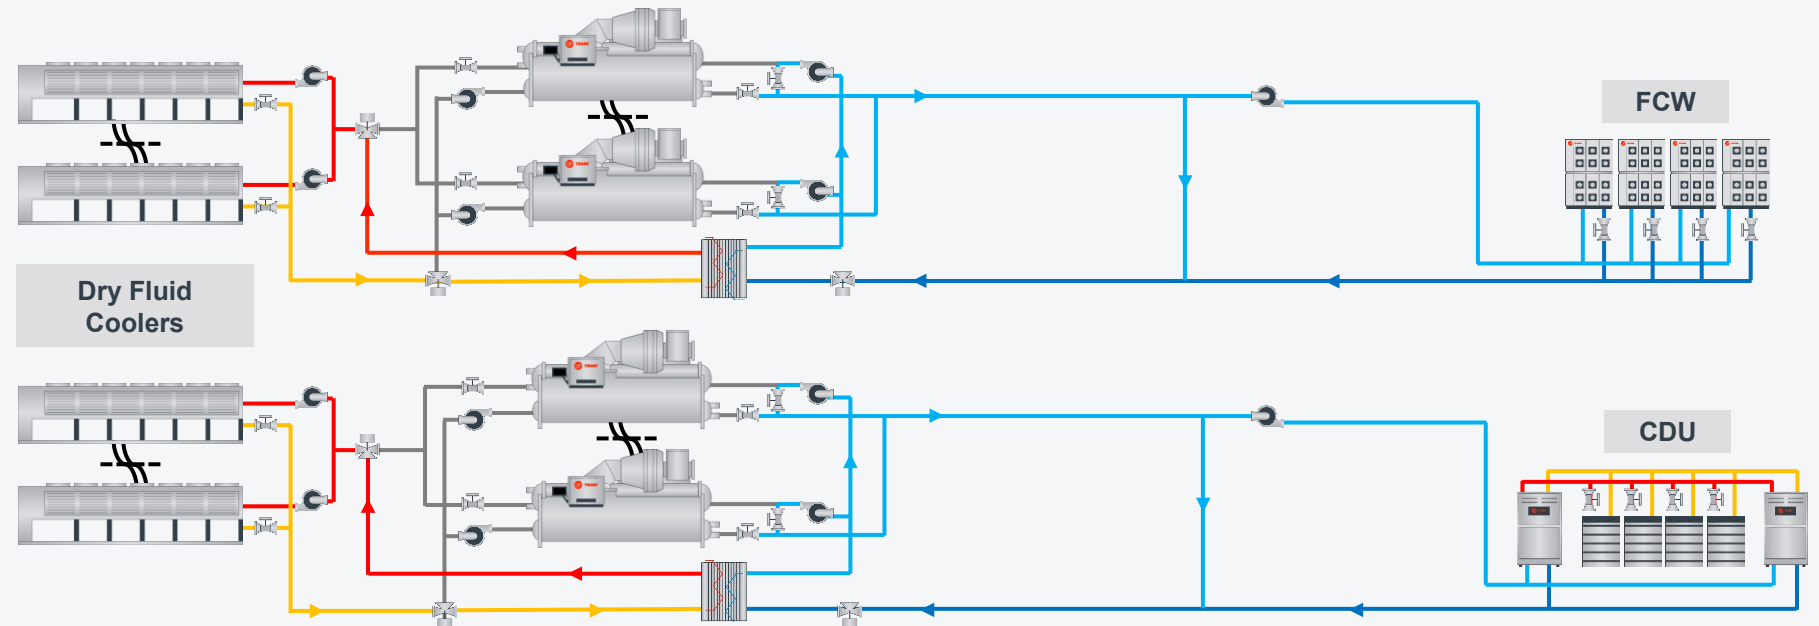


# → BEST PRACTICES

## Redundancy

### Dual-temperature plant with swing chillers

A dual-temperature chiller plant with swing chillers allows redundant units to be flexibly assigned to either the high- or low-temperature loop, reducing the total number of chillers needed when full dual-loop redundancy isn't required.

The swing chillers are selected for multiple modes of operation to ensure they can serve either loop.

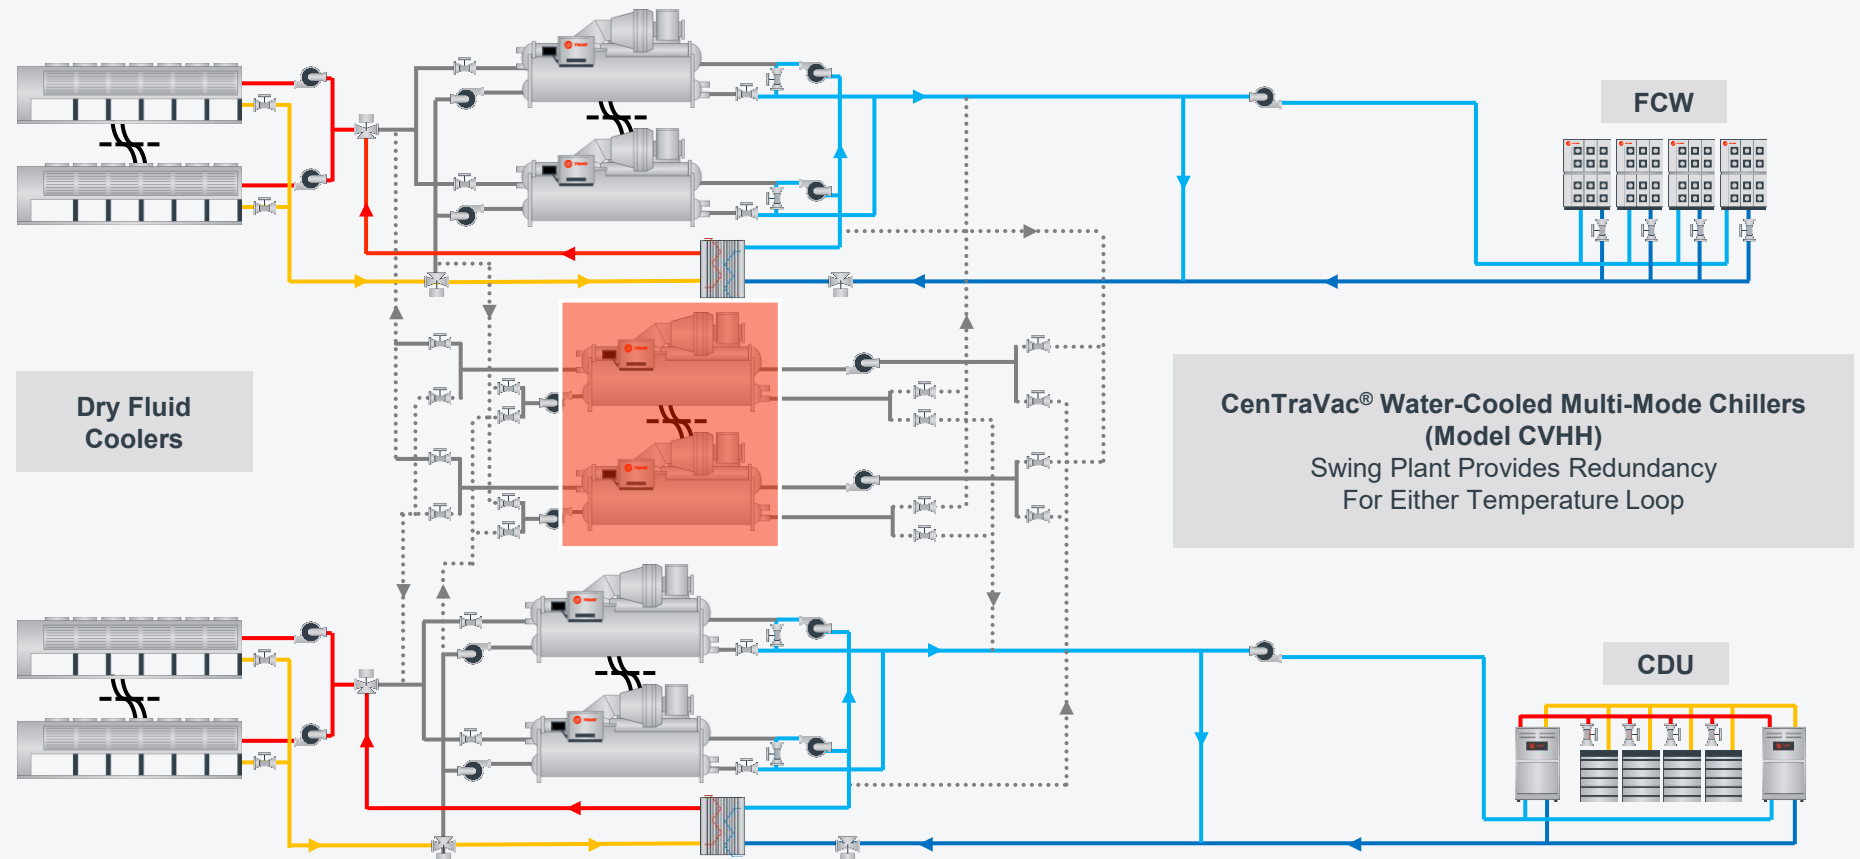


# → BEST PRACTICES

## Block Sizing

Designing a single chiller plant for a 1 GW scale data center is not practical — the pipe, fitting, valve and pump sizes required for such capacity would be prohibitively large. A more effective approach is to divide the load into ~100MW partitions, typically served by 48-inch piping depending on system selections.

- Each partition is served by up to 10 MW CDUs, with 11 CDUs required per partition
- Each 10 MW CDU consists of ~1.6 MW segments, with up to six segments per CDU (assuming N+2 redundancy)
- The number of server racks depends on rack capacity and design
- Remaining site power reserved for airside cooling loop, additional IT loads and other site needs

### Liquid Cooling Block Sizing

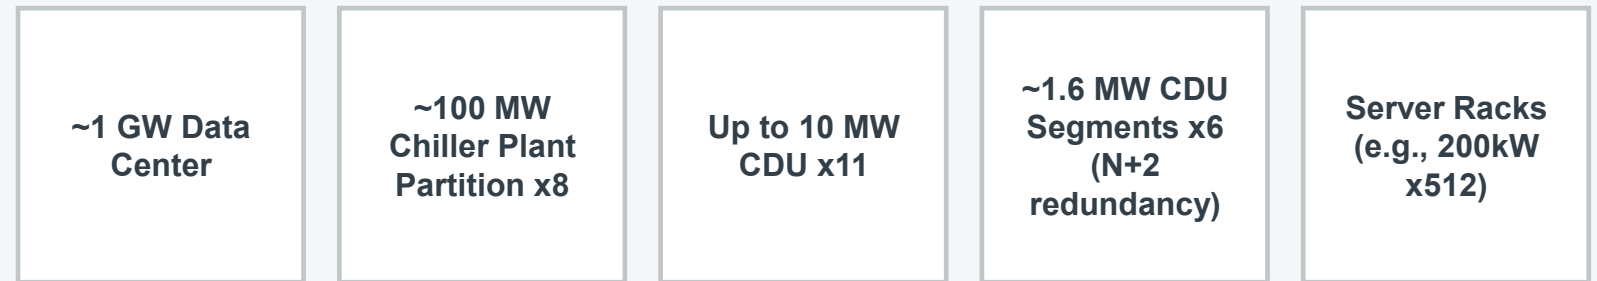

# → BEST PRACTICES

## Free Cooling

Cooling loads are typically designed for the maximum expected demand, or “design point.” In practice, both the cooling load and outdoor ambient temperature fluctuate, creating opportunities for “free cooling” when conditions allow. This reference design uses dry coolers and a plate-and-frame heat exchanger to provide free cooling under favorable ambient temperatures.

Free-cooling capacity depends on the difference between the fluid temperature and outdoor dry-bulb temperature. Operation can be grouped into three modes.

### **Mode 1:**

Outdoor temperature is low enough to provide full cooling without mechanical assistance.

### **Mode 2:**

Outdoor temperature is moderate — free cooling can precool the fluid, reducing chiller energy use.

### **Mode 3:**

Outdoor temperature exceeds fluid temperature — free cooling is bypassed.

# → **BEST PRACTICES**

## Freeze Protection

Outdoor equipment such as dry coolers and exposed piping is at risk of freezing when ambient temperatures drop below the fluid's freeze point. Protection can be achieved by selecting a suitable fluid or by adding heat to maintain temperature above freezing.

- Select a fluid with a freeze point below expected operating conditions
- Add heat to keep local temperatures above the fluid's freeze point

Glycol solutions (propylene or ethylene) have a freeze point, where crystals begin to form, and a burst point, where expansion can cause damage. Proper concentration ensures the fluid remains pumpable and prevents freezing under site conditions.

If water is used, heat must be added to maintain temperature above freezing — especially in heat-rejection devices like dry coolers. The required heat depends on ambient conditions, water volume, and insulation quality.

If glycol is undesirable in the full loop, install isolation heat exchangers and local pumps to confine glycol to small closed loops while maintaining protection for any connected water lines.


# → BEST PRACTICES

## Thermal Energy Storage

Thermal storage can be integrated into the chiller plant in several ways, with tank location determined by system needs. In general, the recommended location for the tank is in the decoupler line.

- **Tank on return side.** When placed on the return side, the tank buffers large temperature swings in water returning to the chillers during rapid load changes. Maintaining stable return temperature helps chillers deliver consistent leaving-water temperature.
- **Tank in the decoupler line.** Locating the tank in the decoupler line includes all the benefits noted above. This location also allows it to act as a thermal battery — charging when production exceeds demand and discharging when demand is higher. This cycle can repeat throughout the day and be optimized by system controls.

Thermal storage tank in the decoupler pipe

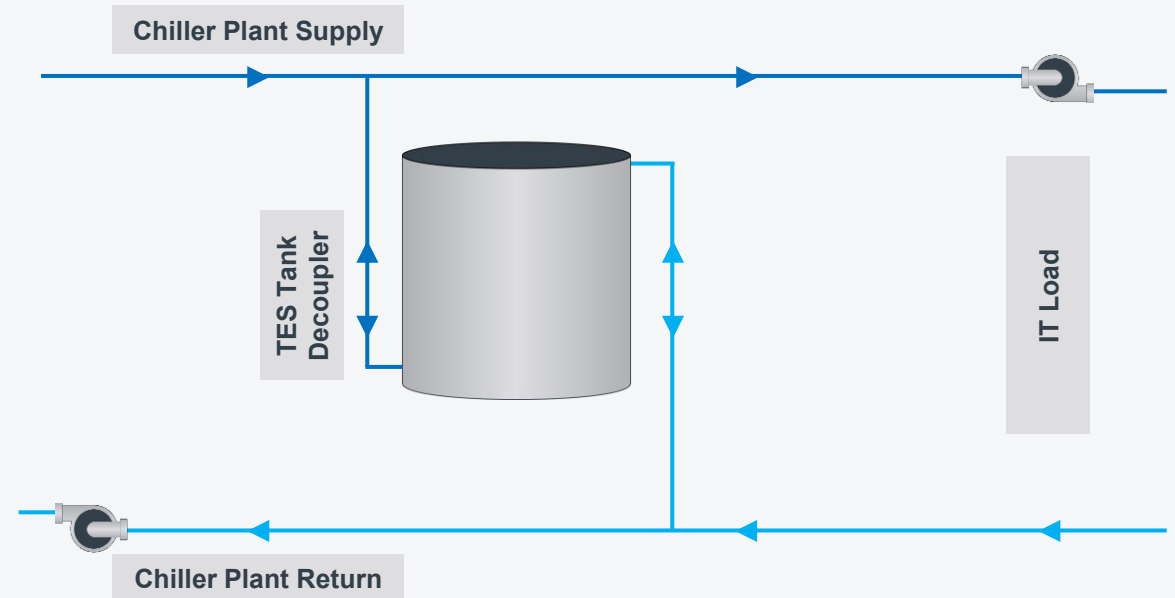




# → **SYSTEM CONTROLS**

Effective controls are critical to chiller plant performance and reliability. Trane's data center-specific control platform promotes efficiency, uptime and responsiveness by integrating all major components — chillers, dry coolers, pumps, valves, CDUs and fan coil walls — into one coordinated system.



SYSTEM CONTROLS

Reference Diagram

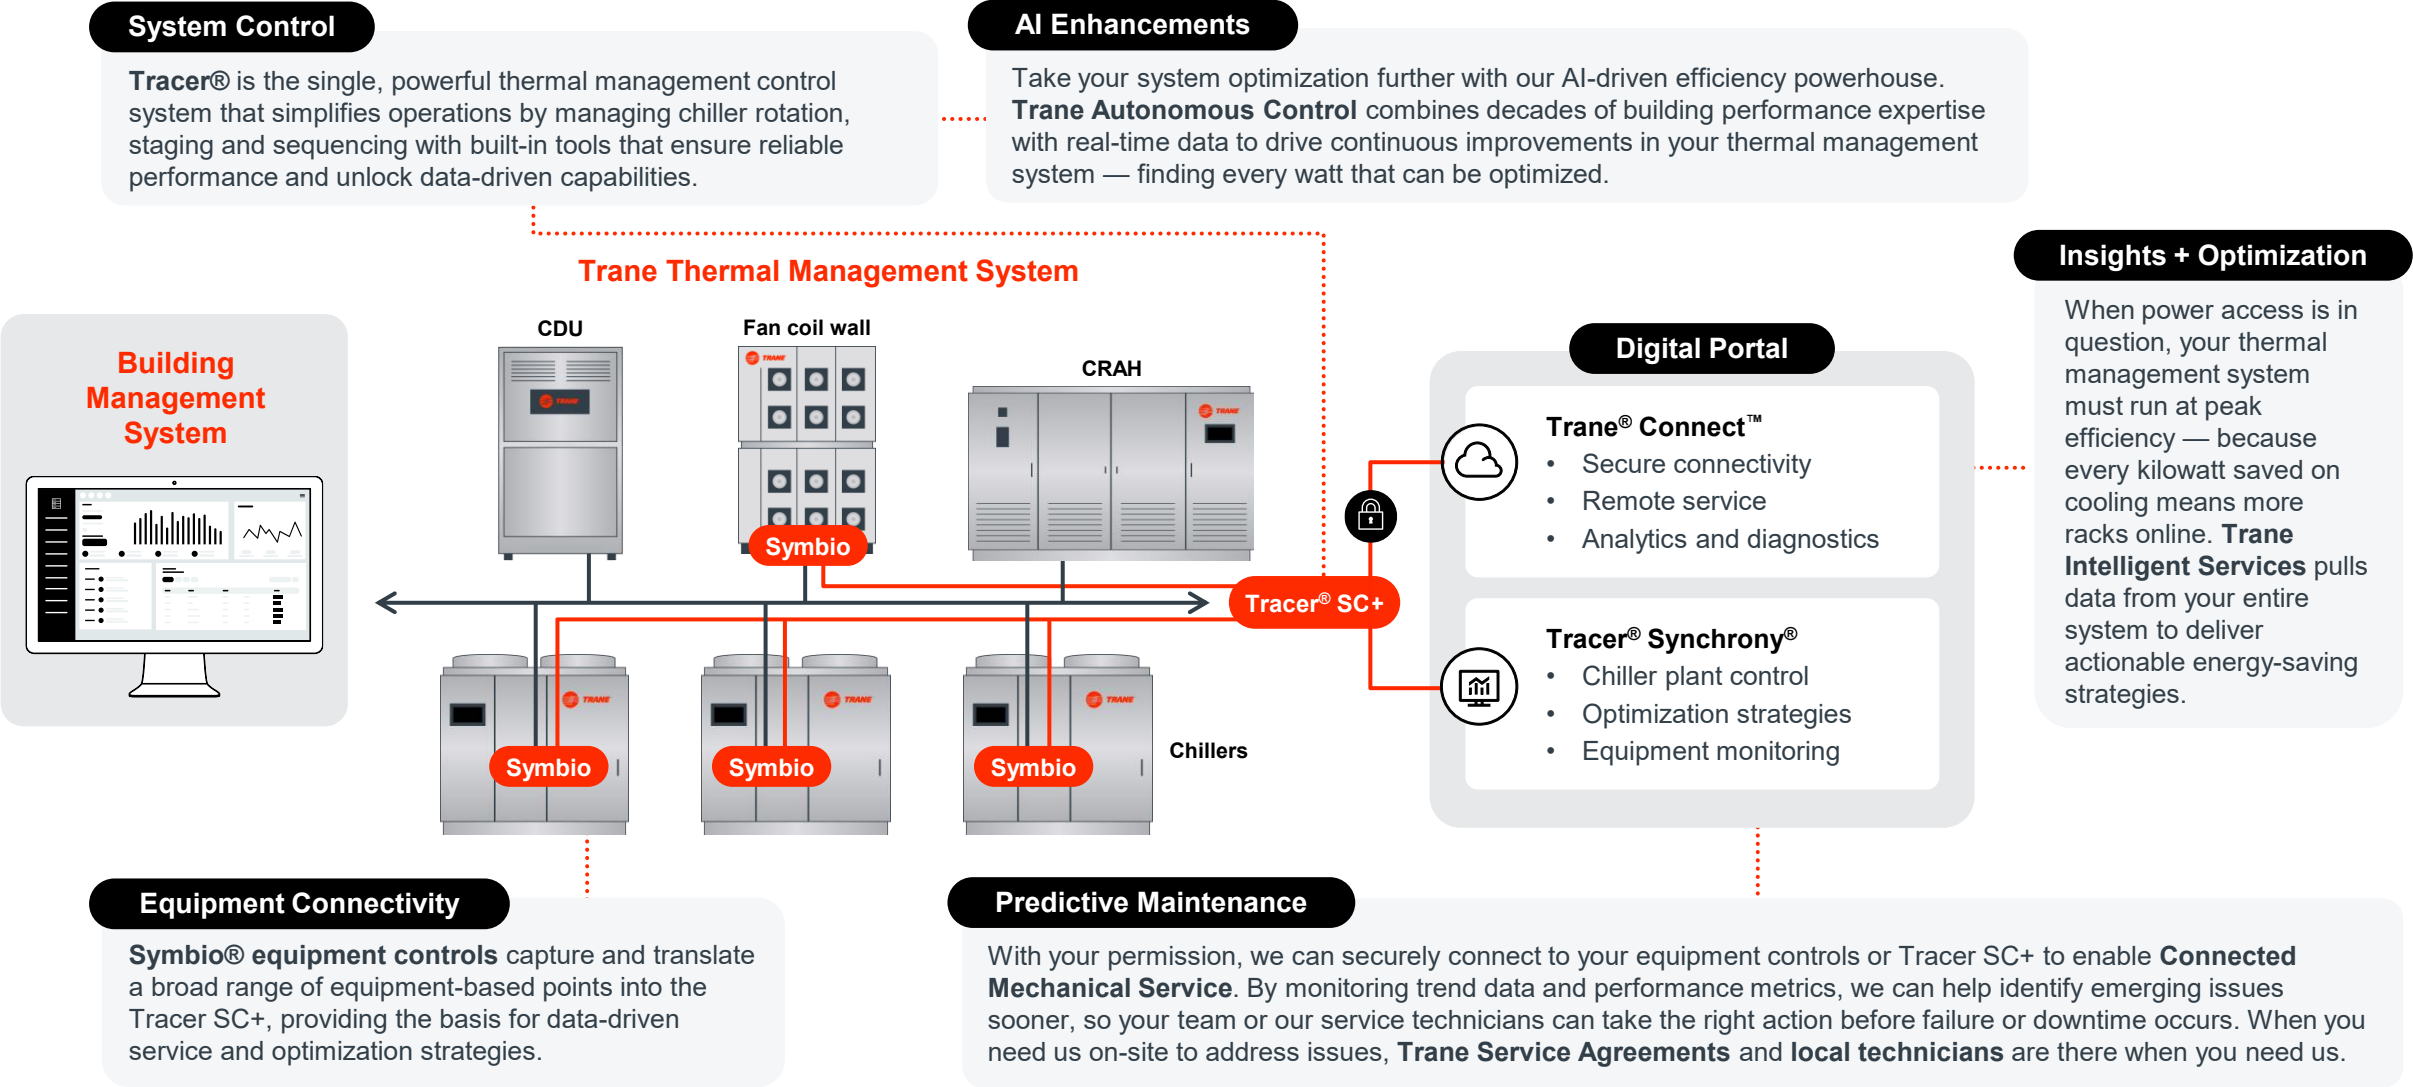



# TRANE SERVICE

As data centers expand in size and complexity, the need for dependable, efficient cooling grows with them. Trane's thermal management services are designed to meet these evolving demands — providing scalable, responsive support that adapts to changing loads, tighter schedules and zero-tolerance uptime requirements.

- Embedded expertise ensures reliable operation from design through expansion and refresh
- Proactive planning helps reduce risk and downtime
- Connected insights help optimize capacity and efficiency across the lifecycle





## → DESIGN RESOURCES

Trane provides a complete suite of resources to support the design of high-performance thermal management systems for data centers.

- All mechanical components are selected for site-specific conditions, with detailed submittal packages available
- System control sequences and operating modes can be customized for any chiller plant configuration
- TRACE™ modeling tools evaluate annual energy performance and efficiency
- Application guides and Trane experts are available to assist with design, optimization and implementation


**Reach out to Trane today for more information.**





# HELPFUL LINKS

Trane BIM and Selection Tools →

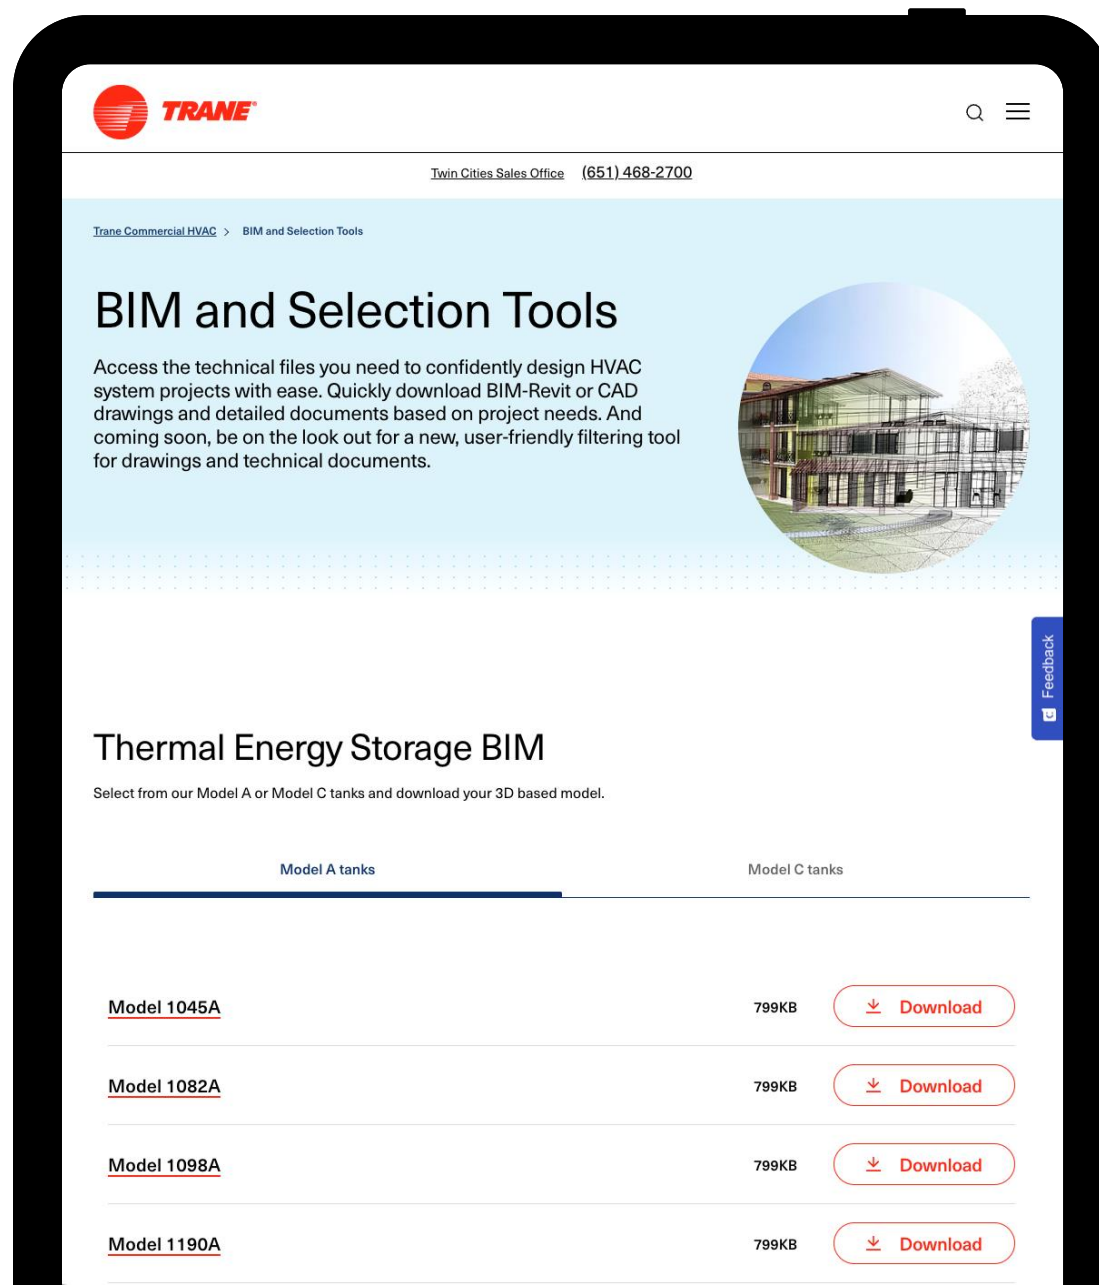

The screenshot shows the Trane website's 'BIM and Selection Tools' page. At the top is the Trane logo and a search icon. Below the logo is the contact information for the Twin Cities Sales Office: (651) 468-2700. The main heading is 'BIM and Selection Tools', followed by a paragraph explaining that users can access technical files for HVAC system projects, download BIM-Revit or CAD drawings, and look out for a new filtering tool. To the right of the text is a circular image of a modern building. Below this is a section for 'Thermal Energy Storage BIM', which instructs users to select from Model A or Model C tanks and download a 3D model. A table lists four models: Model 1045A, Model 1082A, Model 1098A, and Model 1190A, each with a 799KB file size and a 'Download' button. A 'Feedback' button is visible on the right side of the page.

| Model A tanks      | Model C tanks                  |
|--------------------|--------------------------------|
| <u>Model 1045A</u> | 799KB <a href="#">Download</a> |
| <u>Model 1082A</u> | 799KB <a href="#">Download</a> |
| <u>Model 1098A</u> | 799KB <a href="#">Download</a> |
| <u>Model 1190A</u> | 799KB <a href="#">Download</a> |

# Trane.com/DataCenters



**TRANE®**

TRANE  
TECHNOLOGIES

Trane – by Trane Technologies (NYSE: TT), a global climate innovator – creates comfortable, energy efficient indoor environments through a broad portfolio of heating, ventilating and air conditioning systems and controls, services, parts and supply. For more information, please visit [trane.com](https://trane.com) or [tranetechnologies.com](https://tranetechnologies.com).

All trademarks referenced in this document are the trademarks of their respective owners. © 2025 Trane. All Rights Reserved.

DC-PRR001A-EN  
10/27/2025